



S.NO.	DESCRIPTION	QTY.	FLOW RATE	PUMPING HEAD
1.	ELECTRICAL DRIVEN HYDANT PUMP	1 NO.	2850 LPM (171MMH)	90M.
2.	ELECTRICAL DRIVEN SPINNIER PUMP	1 NO.	2850 LPM (171MMH)	90M.
3.	ELECTRICAL DRIVEN JOCKEY PUMP FOR HYDRANT SYSTEM	1 NO.	180 LPM (0.80MMH)	90M.
4.	ELECTRICAL DRIVEN JOCKEY PUMP FOR SPRINKLER SYSTEM	1 NO.	180 LPM (0.80MMH)	90M.
5.	DIESEL ENGINE DRIVEN FIRE PUMPS	2 NOS.	2850 LPM (171MMH)	90M.
6.	ELECTRICAL DRIVEN WATER CISTERN PUMP	1 NO.	2280 LPM (136MMH)	50M.
7.	DIESEL ENGINE DRIVEN FIRE PUMP FOR WATER CISTERN SYSTEM	1 NO.	2280 LPM (136MMH)	50M.

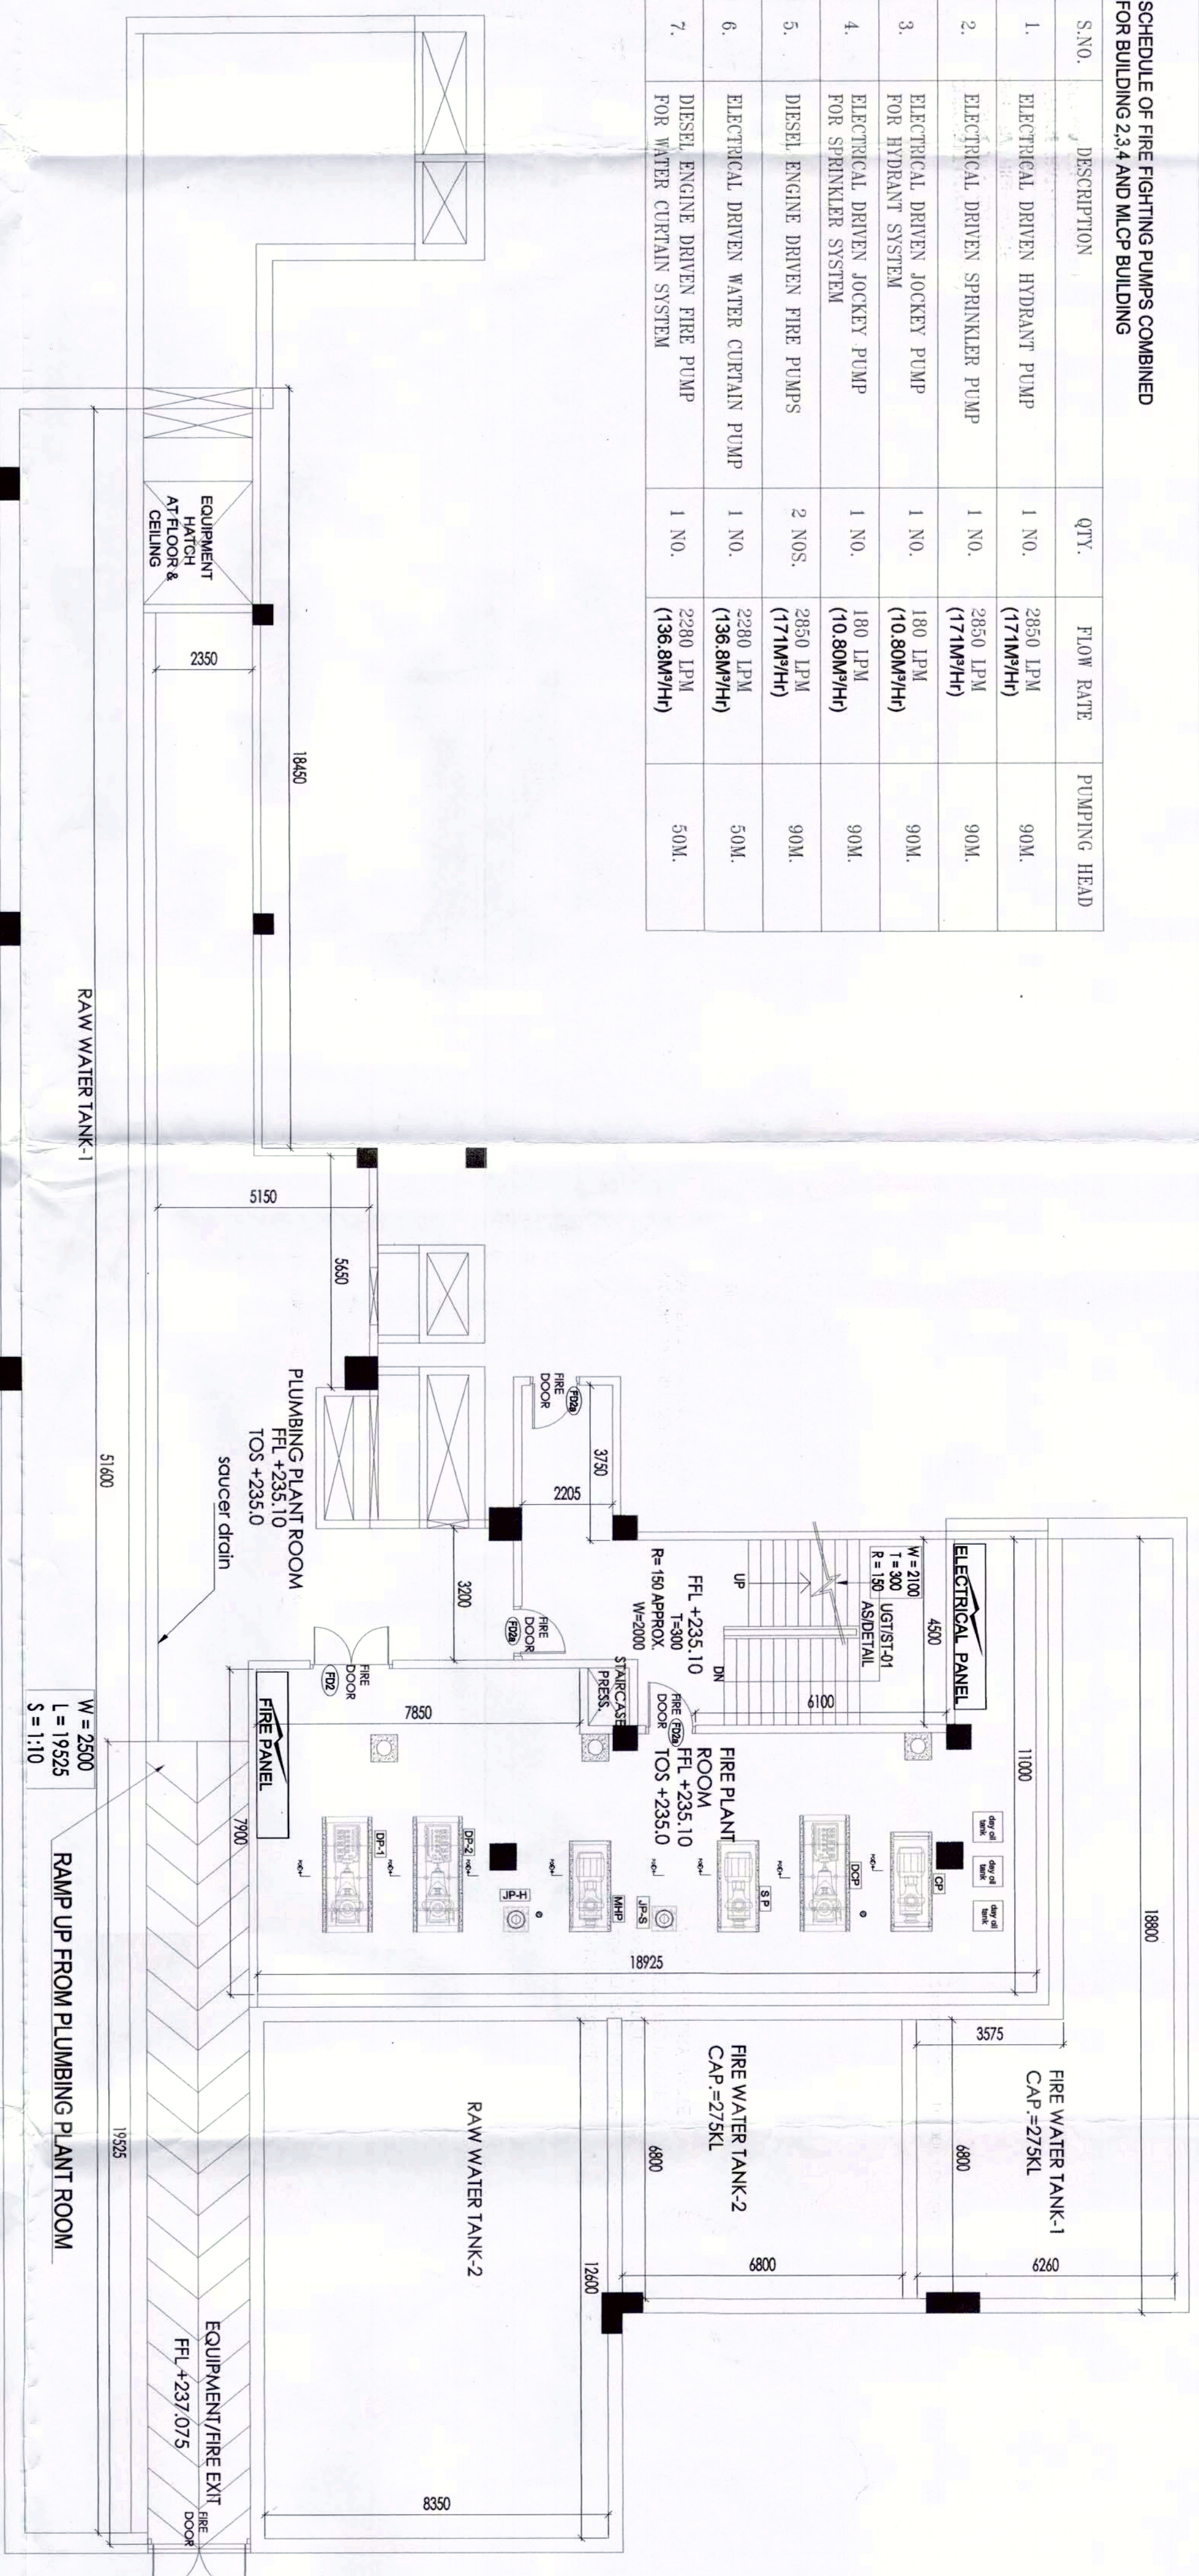

PUMP ROOM

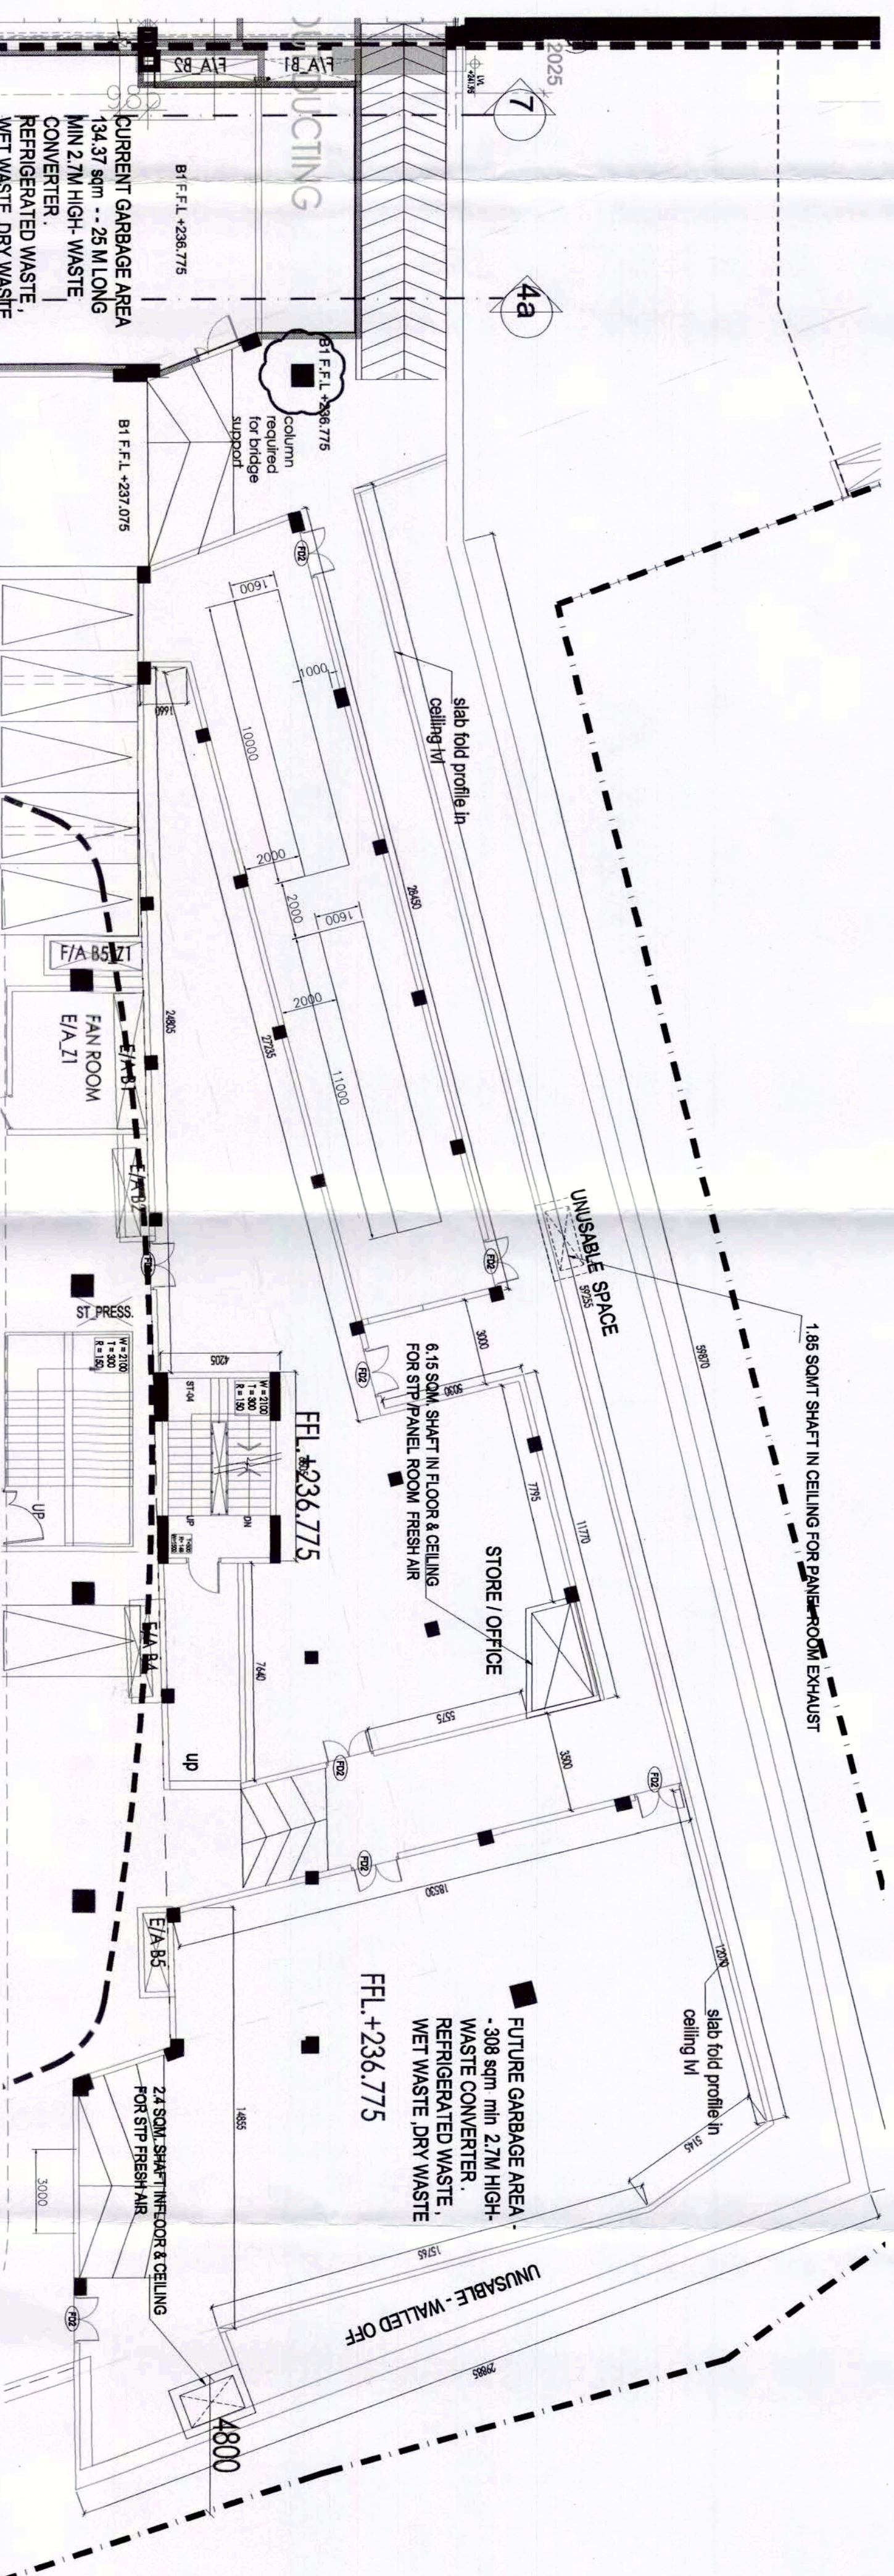

STP- BASEMENT 1



STP ROOM-BASEMENT 2


NOTE:-
ALL PARKING SHOWN ARE NORMAL PARKING

- NOTES:-**
- ALL PIPE DIAMETERS ARE IN MM.
 - ALL CONNECTIONS FLOOR DRAIN TO FLOOR TRAP WILL BE 63 OD UPVC WASTE PIPE.
 - ALL WASTE FROM WASH BASIN TO F.T WILL BE 40 OD UPVC WASTE PIPE.
 - ALL WASTE FROM URINALS TO U.T WILL BE 50 OD UPVC SOIL PIPE.
 - ALL PIPES FROM FT TO STACK WILL BE 110 OD UPVC PIPES OR OTHERWISE SPECIFIED.
 - ALL PIPES FROM WC/UT TO STACK WILL BE 110 OD UPVC PIPES OR OTHERWISE SPECIFIED.

[illegible]

Note :-

1. BUILDING HAS AUTOMATIC SPRINKLER SYSTEM AS REQUIRED BY NBC.
2. BUILDING WILL BE DESIGNED (STRUCTURES) AS PER RELEVANT IS CODES FOR EARTH QUAKE RESISTANCE.
3. BUILDING IS ARTIFICIALLY LIGHTED MECHANICALLY VENTILATED & CENTRALLY AIRCONDITIONED WITH 100% POWER BACKUP

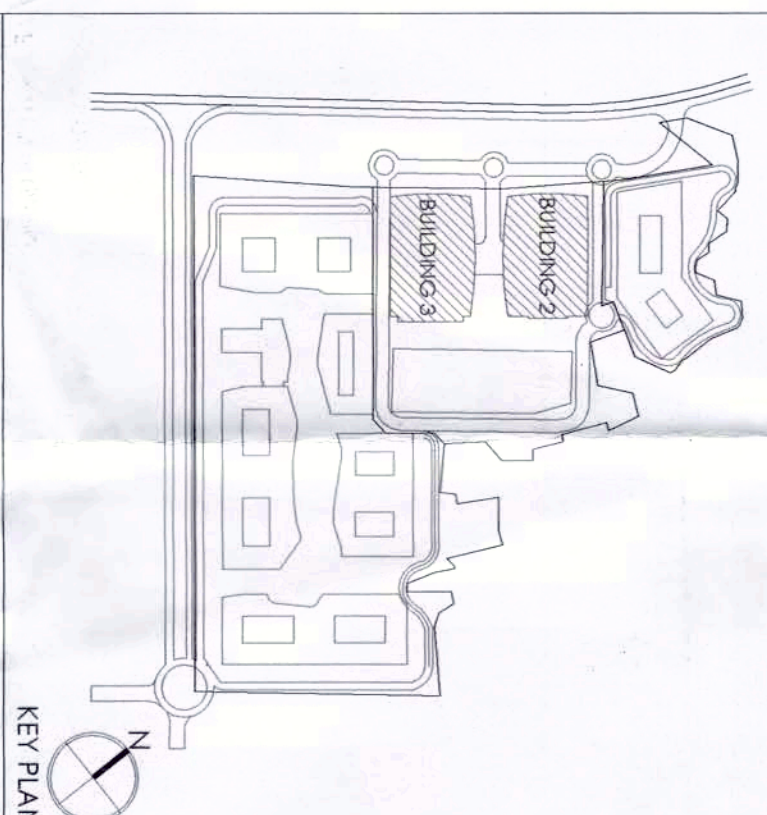

LEGEND FOR PLUMBING:	
8.00	SYMBOL
01	DISPERSION
02	1" TO 2" SOIL PIPE
03	10" TO 16" WASTE PIPE
04	75' OD ANTISEPTIC PIPE
05	DOMESTIC WATER SUPPLY, HYDROPHULUM
06	DOMESTIC WATER SUPPLY, HYDROPHULUM
07	FLUSHING WATER SUPPLY, HYDROPHULUM
08	160' OD TERRACE RAIN WATER PIPE
09	10" DIAM MOUNTAIN/CLON RAIN WATER PIPE
10	FLOOR DRAIN
11	FLOOR TRAP
12	UT 60 FLOOR TRAP
13	COP 11 CLEAN OUT PLUG
14	SOL. PIPE
15	WASTE PIPE
16	VENT PIPE
17	RAIN WATER PIPE
18	DOMESTIC WATER PIPE
19	FLUSHING WATER PIPE
20	100' OD PAVING DRAIN PIPE
21	100' OD FAN ROOM DRAIN PIPE
22	200' OD FAN ROOM DRAIN CHANNEL
23	200' OD FAN ROOM DRAIN CHANNEL WITH 90° BENDING
24	SLOPED DRAIN

Architects:

Arcop Associates Pvt. Ltd.

Plot-36b, Sec-32, Gurgaon-122001
Ph.: +91-124-4595500 FAX: +91-124-4595550
Montreal, Toronto, New-Delhi, Boston

Project:

PROPOSED REVISED BUILDING PLAN OF COMMERCIAL COLONY AREA MEASURING 32.36 ACRES PART OF RESIDENTIAL PLOTTED COLONY NAMELY DLF CITY PHASE III @1 and INDEPENDENT COMMERCIAL COLONY 400 ACRES (LICENCE NO.59 OF 2018 DATED 07.09.2019) BY MAKING TOTAL AREA MEASURING 36.36 ACRES UNDER TDZ ZONE IN SECTOR -24 & 25A DURGIGAU MAHESWAR URBAN COMPLEX BEING DEVELOPED BY DLF LIMITED AND OTHERS.

DRAWING TITLE:-

**PUMP ROOM AND STP LAYOUT
BUILDING-2&3**

100	100
-----	-----

JOB NO:-

SCAFF:-	
---------	--

1:100

FILE:-	DEALT 8
--------	---------

MAL

ARCHITECT'S SEAL
& SIGNATURE

--	--

--	--

William Sarah Stahl.

West
Council of Architecture
Registration No.: CA-9

--	--

[illegible]