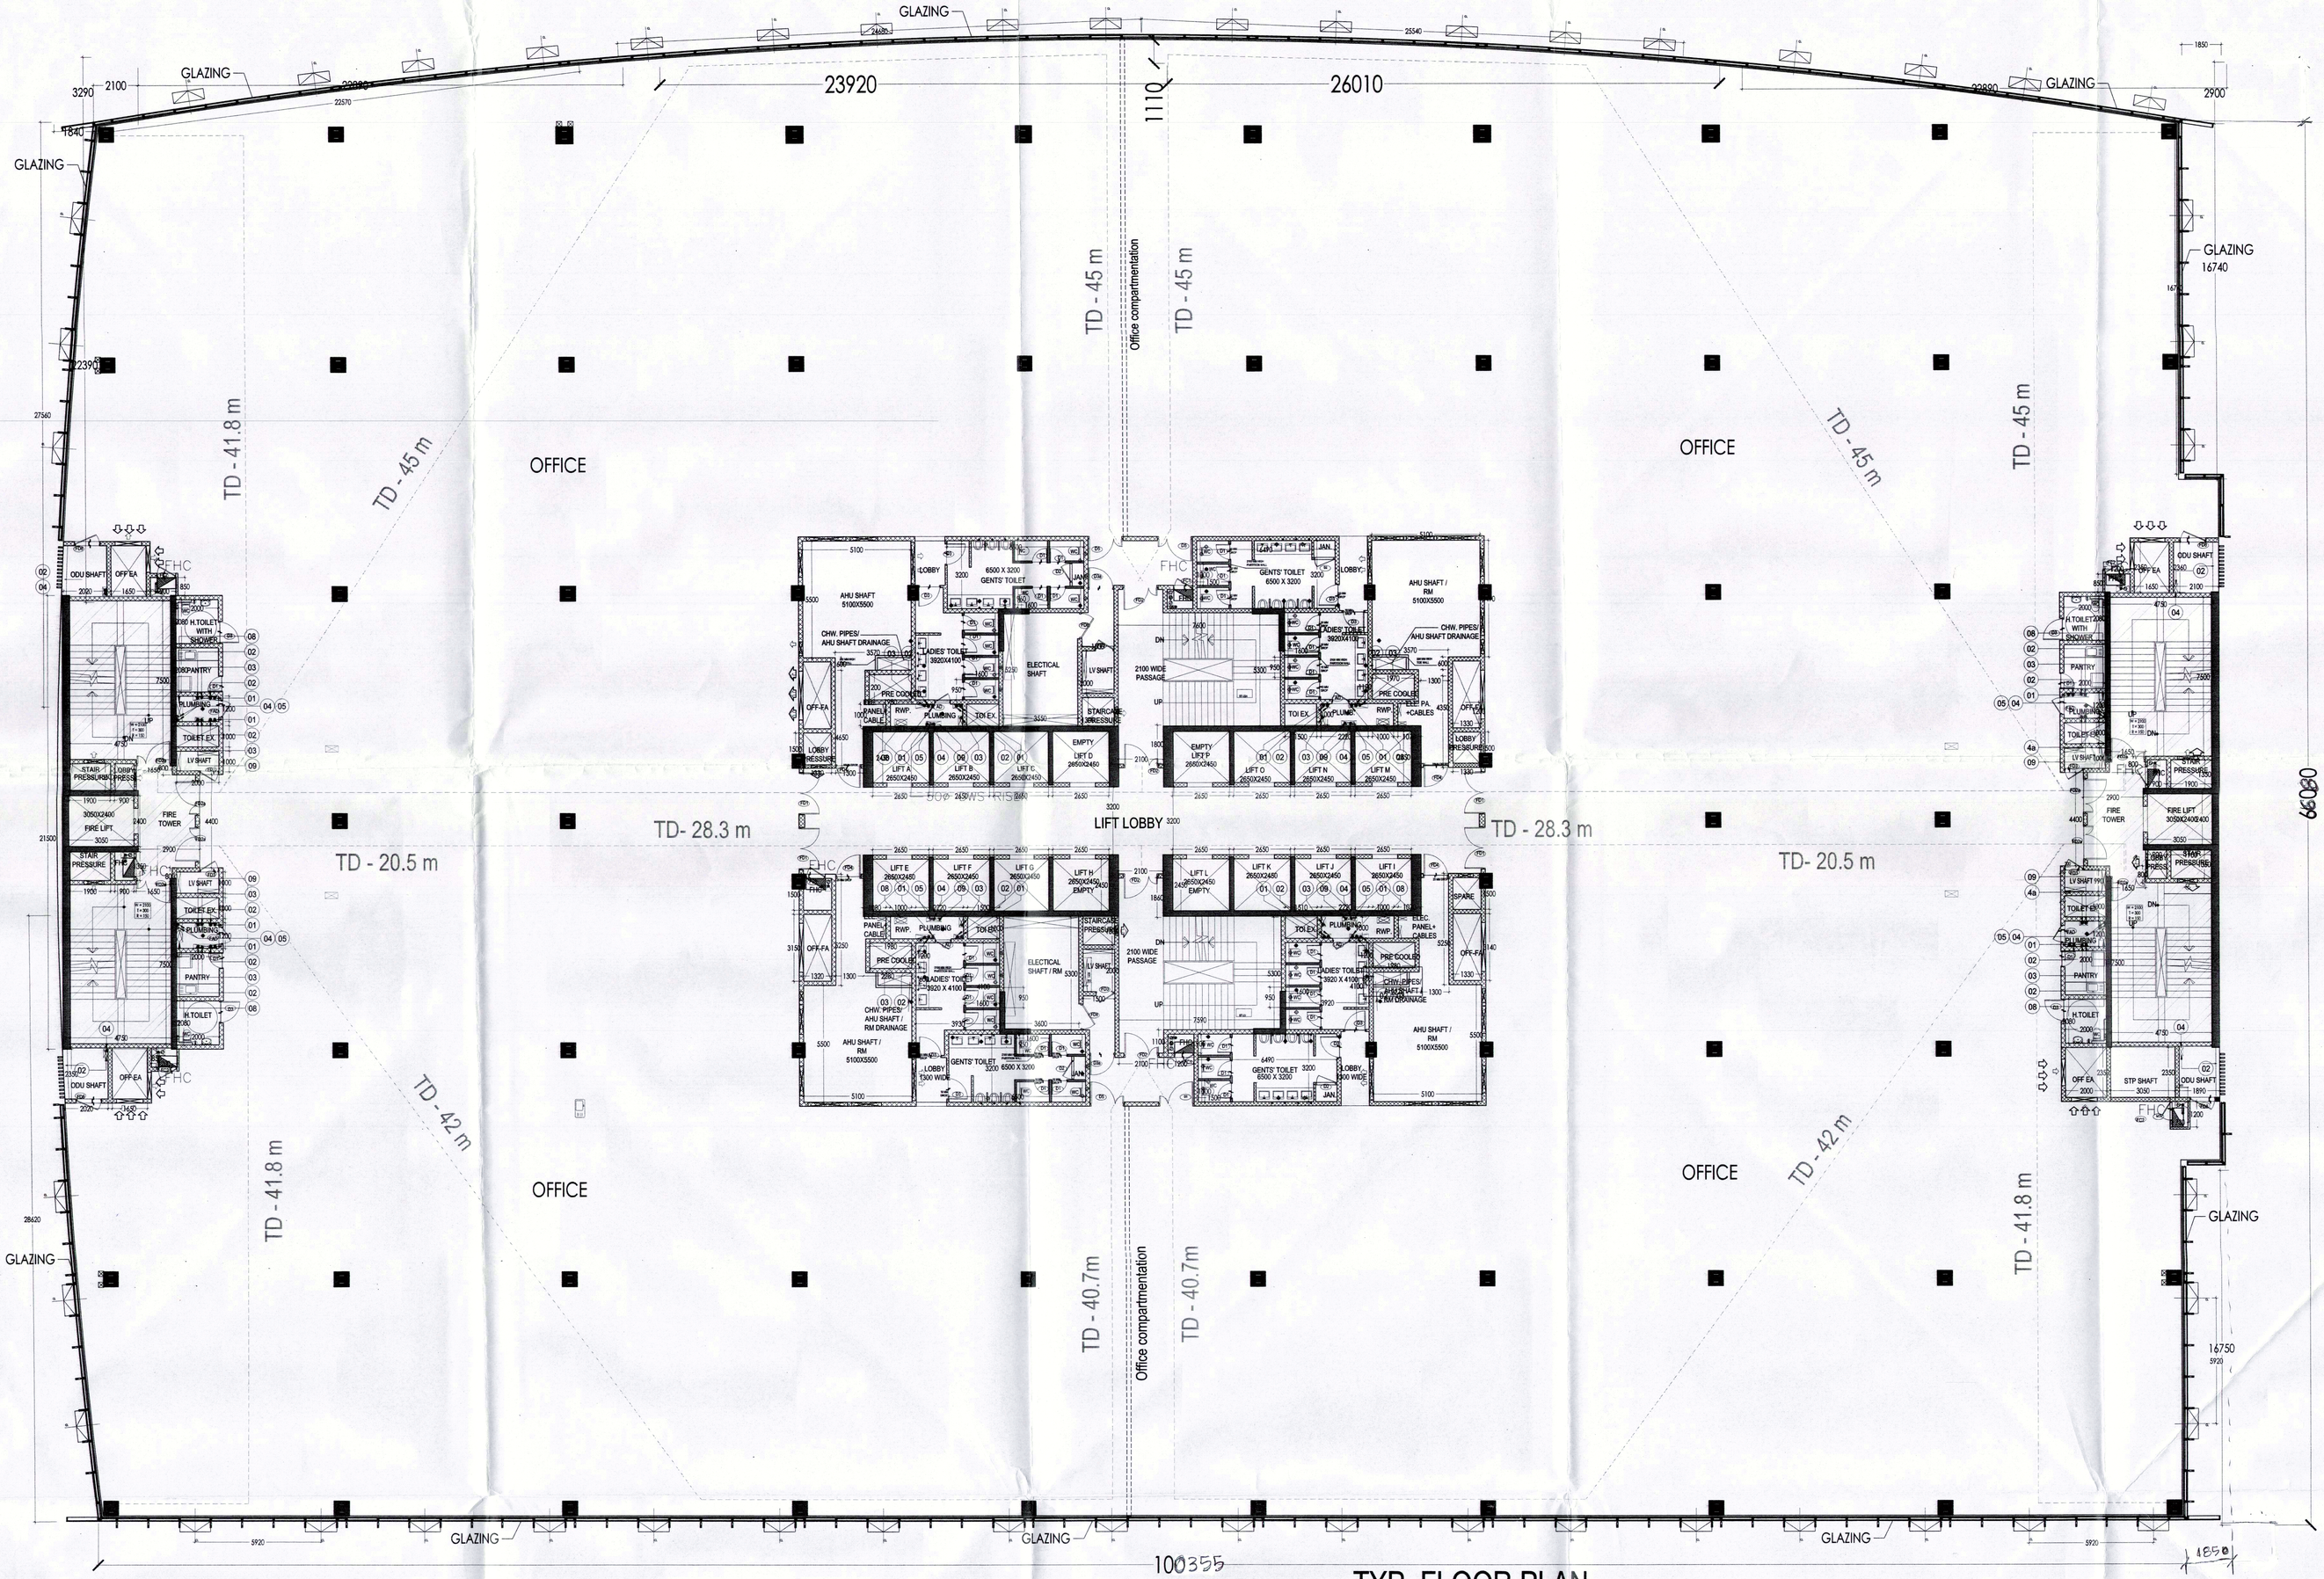

TYP. FLOOR PLAN -
2nd to 5th & 7th to 8th Floor

Note: Openable windows are provided @ c/c distance less than 10 meters.

BUILDING-3		
FLOOR	LVL	USAGE
2nd	+8890	Office
3rd	+13090	Office
4th	+17290	Office
5th	+21490	Office
7th	+29890	Office
8th	+34090	Office

DOOR WINDOW SCHEDULE

S.NO.	SIGNS	WIDTH(mm)	HEIGHT(mm)	SILL HT.	LEVEL (+)	REMARKS	LOCATION	FIRE RATING
1	D1	800	2700	0	0133	WOODEN DOOR	TOILET (SINGLE LEAF)	
2	D2	900	2000	100	0133	WOODEN DOOR	JANITOR ROOM	
3	D3	1000	2700	0	0133	WOODEN DOOR	SUMP	
4	D3A	1000	2400	0	0413	WOODEN DOOR	DOOR SERVICE CORE - MAIN CORE ENTRANCE DOOR	
5	D3B	1000	2100	0	0133	WOODEN DOOR	DOOR SERVICE CORNER ENTRANCE DOORS	
6	D3C	1000	2100	0	0133	WOODEN DOOR	PANTRY	
7	D4	1200	2400	0	0413	WOODEN DOOR	FIRST FLOOR CONFERENCE	
8	D5	1620	2400	0	0413	WOODEN DOOR	DUPLEX CORE LOBBY	
9	D6	2000	2400	0	0413	WOODEN DOOR	GROUND FLOOR CAFE/ MEDICAL ROOM	
10	D7	1330	2400	0	0413	WOODEN DOOR	CORRIDOR BUILDING 4	
11	D7A	1330	2400	0	0413	WOODEN DOOR		
12	D8	2000	2400	0	0413	WOODEN DOOR	MAIN ENTRANCE	
13	D10	3000	2400	0	0413	WOODEN DOOR	MAIN ENTRANCE	
14	D11	1680	2400	0	0413	WOODEN DOOR	BAGGAGE AND SECURITY CHECK	
15	FC1	900	2200	100	0413	METAL FIRE DOOR	FACU	
16	FC2	900	2200	100	0133	METAL FIRE DOOR	EDGE CONN.F.A.C.	
17	AD	750	2000	100	0133	DOOR	PLUMBING SHAFT	
18	FAD	750	2000	100	0133	METAL FIRE DOOR	PLUMBING SHAFT	60 min FIRE RATED DOOR
19	FD1	2000	2400	0	0413	METAL FIRE DOOR	TYPICAL LOBBY ENTRANCE DOOR	2 HOUR FIRE RATED DOOR
20	FD2	1620	2400	0	0413	METAL FIRE DOOR	STAIRCASE ENTRANCE DOOR	2 HOUR FIRE RATED DOOR
21	FD2A	1620	2700	0	0113	METAL FIRE DOOR	LIFT LOBBY	2 HOUR FIRE RATED DOOR
22	FD2B	1620	2400	0	0413	METAL FIRE DOOR	L.G.LOBBY	2 HOUR FIRE RATED DOOR
23	FD2C	1200	2700	0	0113	METAL FIRE DOOR	STAIRCASE	2 HOUR FIRE RATED DOOR
24	FD3	900	2100	0	0113	METAL FIRE DOOR	L.V ROOM / SHAFT	2 HOUR FIRE RATED DOOR
25	FD4	1200	2400	0	0413	METAL FIRE DOOR	A.H.U ROOM	2 HOUR FIRE RATED DOOR
26	FD5	1200	2100	0	0113	METAL FIRE DOOR	D.G.SET/SERVICE ROOM	2 HOUR FIRE RATED DOOR
27	FD8A	1200	2100	100	0213	METAL FIRE DOOR	ELECTRICAL ROOM	2 HOUR FIRE RATED DOOR
28	FD8B	1200	2200	0	0113	METAL FIRE DOOR	BMS CONTROL ROOM	2 HOUR FIRE RATED DOOR
29	FD9	2000	2700	100	0813	METAL FIRE DOOR	L.T PANEL ROOM	2 HOUR FIRE RATED DOOR
30	FD11	1000	2100	0	0113	METAL FIRE DOOR	SECURITY ROOM / ELECT. SHAFT	2 HOUR FIRE RATED DOOR
31	FD13	2000	2800	100	0913	METAL FIRE DOOR	H.T PANEL ROOM / EQUATOR ROOM	2 HOUR FIRE RATED DOOR
32	FD15	900	2100	100	0213	METAL FIRE DOOR	TYPICAL FLR. L.T PANEL ROOM / BATTERY ROOM	2 HOUR FIRE RATED DOOR
33	FD19	1000	2100	100	0213	METAL FIRE DOOR	BATTERY ROOM	2 HOUR FIRE RATED DOOR

PIPE DIA'S		
S.NO.	SYMBOL	DESCRIPTION
1	WB. TO FT	40 OD
2	URINAL TO UT	50 OD
3	FD. TO FT	63 OD
4	FT/UT TO VERTICAL STACK	110 OD
5	WC. TO VERTICAL STACK	110 OD

NOTES:-
- ALL PIPE DIAMETERS ARE IN MM.
- ALL CONNECTIONS FLOOR DRAIN TO FLOOR TRAP WILL BE 63 OD UPVC WASTE PIPE.
- ALL WASTE FROM WASH BASIN TO F.T WILL BE 40 OD UPVC WASTE PIPE.
- ALL WASTE FROM URINALS TO U.T WILL BE 50 OD UPVC SOIL PIPE.
- ALL PIPES FROM FT TO STACK WILL BE 110 OD UPVC PIPES OR/OTHERWISE SPECIFIED.
- ALL PIPES FROM WC/UT TO STACK WILL BE 110 OD UPVC PIPES OR/OTHERWISE SPECIFIED.

This is a "PROVISIONAL BUILDING PLAN" approved only for the purpose of inviting objections from the general public

STP(HQ) Member Secretary BPAC · ATP(HQ) Member BPAC · CTP(HQ) Chairman BPAC

AD(HQ)

DDT(HQ) Member BPAC

JD · PA · AMP

Note :-
1. BUILDING HAS AUTOMATIC SPRINKLER SYSTEM AS PER REQUIRED BY NBC.
2. BUILDING WILL BE DESIGNED (STRUCTURES) AS PER RELEVENT IS CODES FOR EARTH QUAKE RESISTANCE.
3. BUILDING IS ARTIFICIALLY LIGHTED MECHANICALLY VENTILATED & CENTRALLY AIRCONDITIONED WITH 100% POWER BACKUP

KEY PLAN

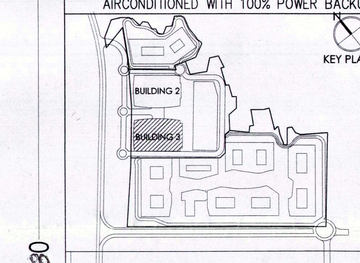

LEGEND FOR PLUMBING:-

S.NO.	SYMBOL	DESCRIPTION
01.	(1)	110 OD SOIL PIPE
02.	(2)	110 OD WASTE PIPE
03.	(3)	75 OD ANTISYPHONAGE PIPE
04.	(4)	DOMESTIC WATER SUPPLY HYDROPNAUMATIC
05.	(4a)	DOMESTIC WATER SUPPLY HYDROPNAUMATIC
06.	(5)	FLUSHING WATER SUPPLY HYDROPNAUMATIC
07.	(6)	160 OD TERRACE RAIN WATER PIPE
08.	(7)	110 OD MUMTY/BALCONY RAIN WATER PIPE
09.	FD	FLOOR DRAIN
10.	FT	FLOOR TRAP
11.	UT	URINAL TRAP
12.	COP	CLEAN OUT PLUG
13.		SOIL PIPE
14.		WASTE PIPE
15.		VENT PIPE
16.		RAIN WATER PIPE
17.		DOMESTIC WATER PIPE
18.		FLUSHING WATER PIPE

Architects:
Arcop Associates Pvt. Ltd.
Plot- 36b, Sec-32, Gurgaon-122001
Ph.: +91-124-4595500 FAX: +91-124-4595550
Montreal, Toronto, New-Delhi, Boston

Project:

PROPOSED /REVISED BUILDING PLAN OF COMMERCIAL
COLONY AREA MEASURING 32.36 ACRES PART OF RESIDENTIAL PLOTTED COLONY NAMELY DLF CITY,PHASE I,II &III AND INDEPENDENT COMMERCIAL COLONY 4.00 ACRES (LICENCE NO.59 OF 2018
DATED 07.09.2018) BY MAKING TOTAL AREA MEASURING 36.36 ACRES UNDER TOD ZONE IN SECTOR -24 & 25A GURUGRAM MANESAR URBAN COMPLEX BEING DEVELOPED BY DLF LIMITED AND OTHERS.

Checked and found ok for Public Health (Internal) Service only subject to comments in in Karam(HQ) level file. CE(HQ) 20/4/21

Additional Chief Engineer (HQ) HSVP, Panchkula

DRAWING TITLE:-
TYP. FLOOR PLAN
(2nd TO 5th & 7th TO 8th Floor)
BUILDING 3

JOB NO:-	DRG NO.	NORTH:-
	DTN/B3/07	N
SCALE:- 1:100	DATE:- 25-05-2021	
FILE:-	DEALT BY:- MALTI	CHECKED BY: VIKRAM · APPROVED BY:VIKRAM
ARCHITECT'S SEAL & SIGNATURE		OWNER'S SEAL & SIGNATURE

Vikram Singh Saini, Architect Council of Architecture Registration No.: CA/94/17163

For DLF Limited
Authorised Signatory