

Note :-

1. BUILDING WILL BE DESIGNED (STRUCTURES)
AS PER RELEVANT IS CODES FOR EARTHQUAKE
RESISTANCE.

PROJECT
PROPOSED BUILDING PLAN OF RESIDENTIAL COLONY
UNDER NEW INTEGRATED LICENSING POLICY (NILP)
DATED 11.05.2022 ON LAND MEASURING 116.9625
ACRES (LICENCE NO. 219 OF 2023 DATED 25-10-23)
(AN AREA MEASURING 103.0625 ACRES MIGRATION
FROM LICENCE NO. 27 OF 2012 DATED 02.04.2012
AND 13.24 ACRES AS FRESH AS FRESH APPLIED AREA)
IN SECTOR-76 & 77, GURUGRAM MANESAR URBAN
COMPLEX BEING DEVELOPED BY DLF LTD IN
COLLABORATION WITH LAND OWNERS AND
IT'S ASSOCIATE COMPANIES

DESIGN ARCHITECTS
Arccon Associates Pvt. Ltd.
Plot No.-36B, Institutional Area,
Sector-32, Gurgaon,
Haryana-122001.


ASSOCIATE ARCHITECTS
RISIMIS
ARCHITECTS
RSMs ARCHITECTS PVT. LTD.
69, Nora Nivas, Bhawani Kunj
(Behind D2), Vasant Kunj,
New Delhi-110070.
Tel:-011-26898616, 26898617
www.rsmis-arch.com

Handwritten signatures and stamps:
ATP(HQ) Consultant Architect
RANCHOH
TO BE READ WITH THIS OFFICE
MEMO NO. 42263
DATED: 13-12-2023
Stamp: Haryana State
Stamp: Haryana State
Stamp: Haryana State

ARCHITECT'S SEAL
& SIGNATURE
OWNER'S SEAL
& SIGNATURE
Handwritten signatures and stamps:
Stamp: Haryana State
Stamp: Haryana State
Stamp: Haryana State

SEP-2023 Scale : 1:250
Drawing Title:-
BASEMENT-02(PART-02 & PART-03)
(UNDER TOWER - E, F) &
(UNDER TOWER - G)
Drawing No:-
BS-02a

SHAFT PIPE DETAIL			DOOR AND WINDOW SCHEDULE		
SYMBOL	ABBREVIATION	DESCRIPTION	WIDTH	HEIGHT	LABEL
①	F	100MM MS FIRE RISER PIPE (LOWER ZONE)	100	1000	1000
②	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
③	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
④	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑤	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑥	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑦	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑧	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑨	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑩	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑪	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑫	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑬	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑭	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑮	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑯	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑰	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑱	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑲	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
⑳	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉑	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉒	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉓	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉔	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉕	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉖	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉗	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉘	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉙	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉚	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉛	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉜	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉝	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉞	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㉟	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊱	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊲	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊳	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊴	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊵	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊶	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊷	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊸	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊹	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊺	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊻	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊼	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊽	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊾	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
㊿	F	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
1	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
2	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
3	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
4	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
5	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
6	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
7	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
8	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
9	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
10	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
11	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
12	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
13	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
14	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
15	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
16	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
17	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
18	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
19	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
20	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
21	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
22	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
23	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
24	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
25	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
26	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
27	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
28	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
29	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
30	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
31	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
32	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
33	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
34	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
35	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
36	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
37	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
38	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
39	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
40	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
41	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
42	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
43	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
44	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
45	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
46	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
47	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
48	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
49	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
50	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
51	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
52	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
53	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
54	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
55	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
56	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
57	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
58	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
59	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
60	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
61	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
62	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
63	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
64	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
65	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
66	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
67	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
68	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
69	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
70	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
71	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
72	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
73	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
74	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
75	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
76	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
77	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
78	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
79	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
80	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
81	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
82	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
83	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
84	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
85	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
86	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
87	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
88	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
89	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
90	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
91	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
92	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
93	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
94	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
95	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
96	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
97	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
98	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
99	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000
100	W	100MM MS FIRE RISER PIPE (UPPER ZONE)	100	1000	1000

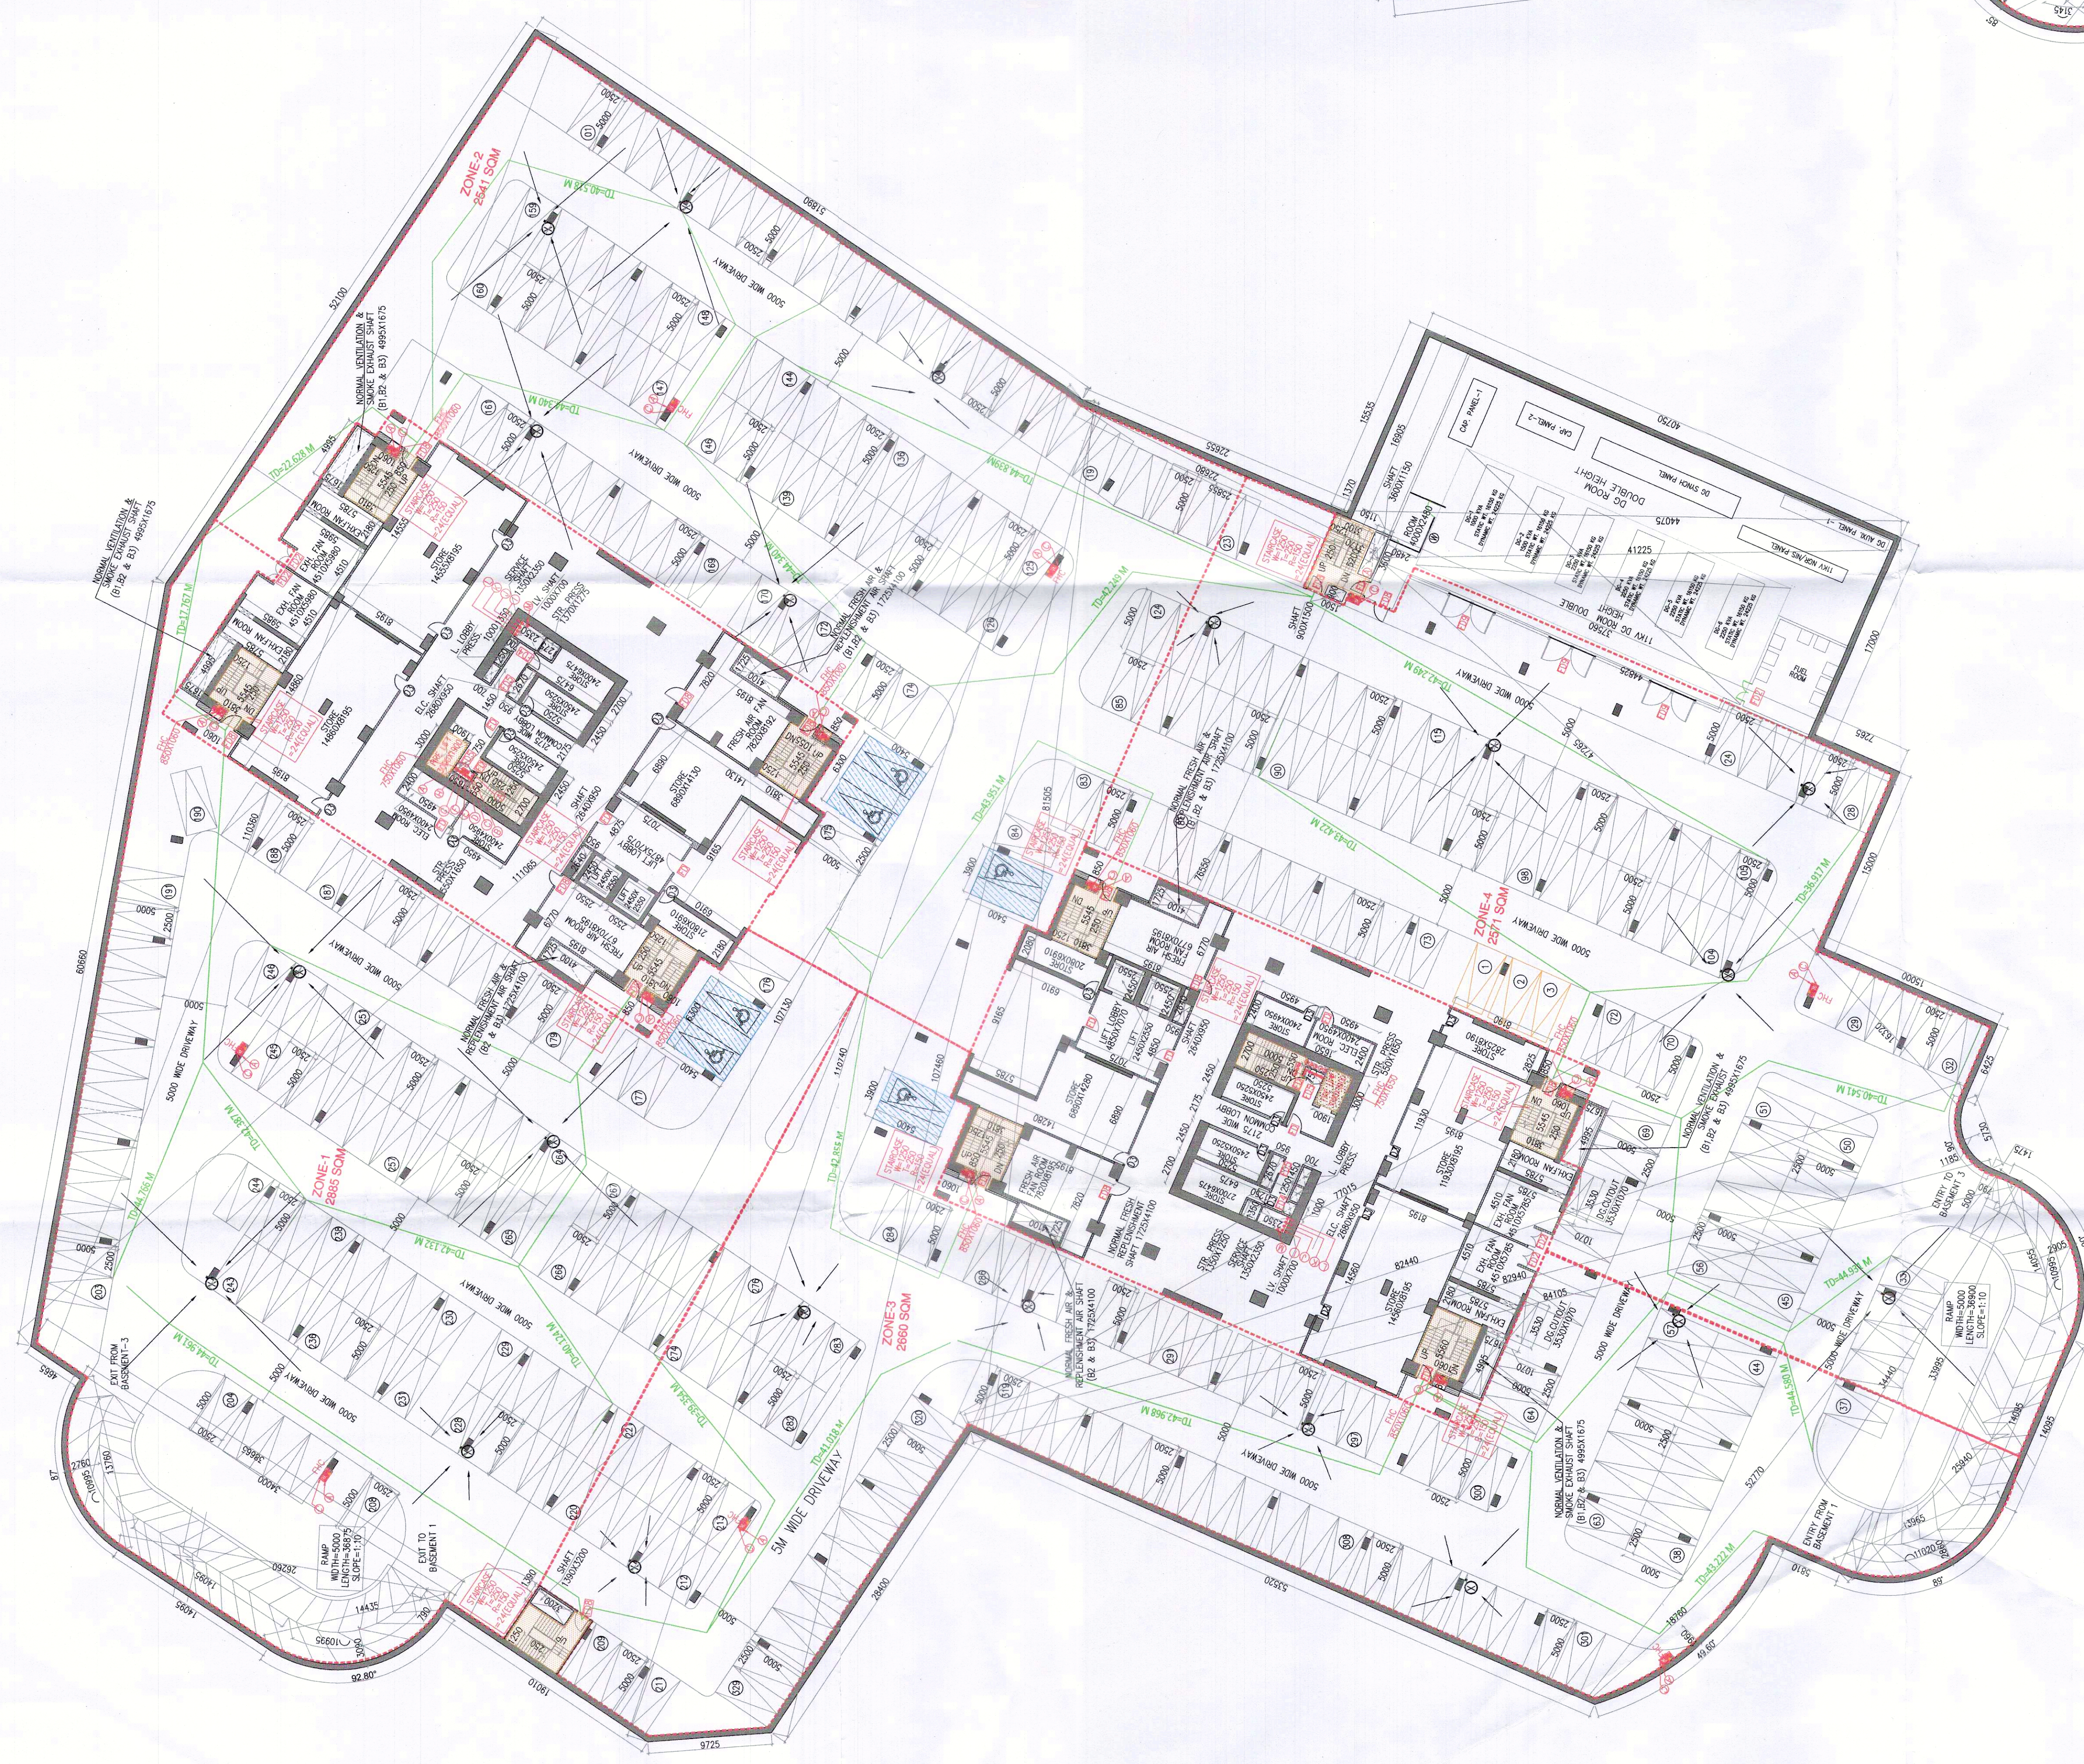

BASEMENT - 2 (PART-2) TOWER-E & F			LEVEL	TOTAL
PARKING TYPE LEGEND				
SINGLE PARKING				329
HANDICAP PARKING				06
TOTAL CAR PARKING				335
CAR WASH				3



BASEMENT - 2 (PART-3) TOWER-G			LEVEL	TOTAL
PARKING TYPE LEGEND				
SINGLE PARKING				167
HANDICAP PARKING				04
TOTAL CAR PARKING				171

Checked and found ok for Public Health
(Internal) Service only subject to approval
in forwarding letter No. 364/2023 dated 13/12/2023
Supervising Engineer (H.O.)
HSPV Panipat
Haryana