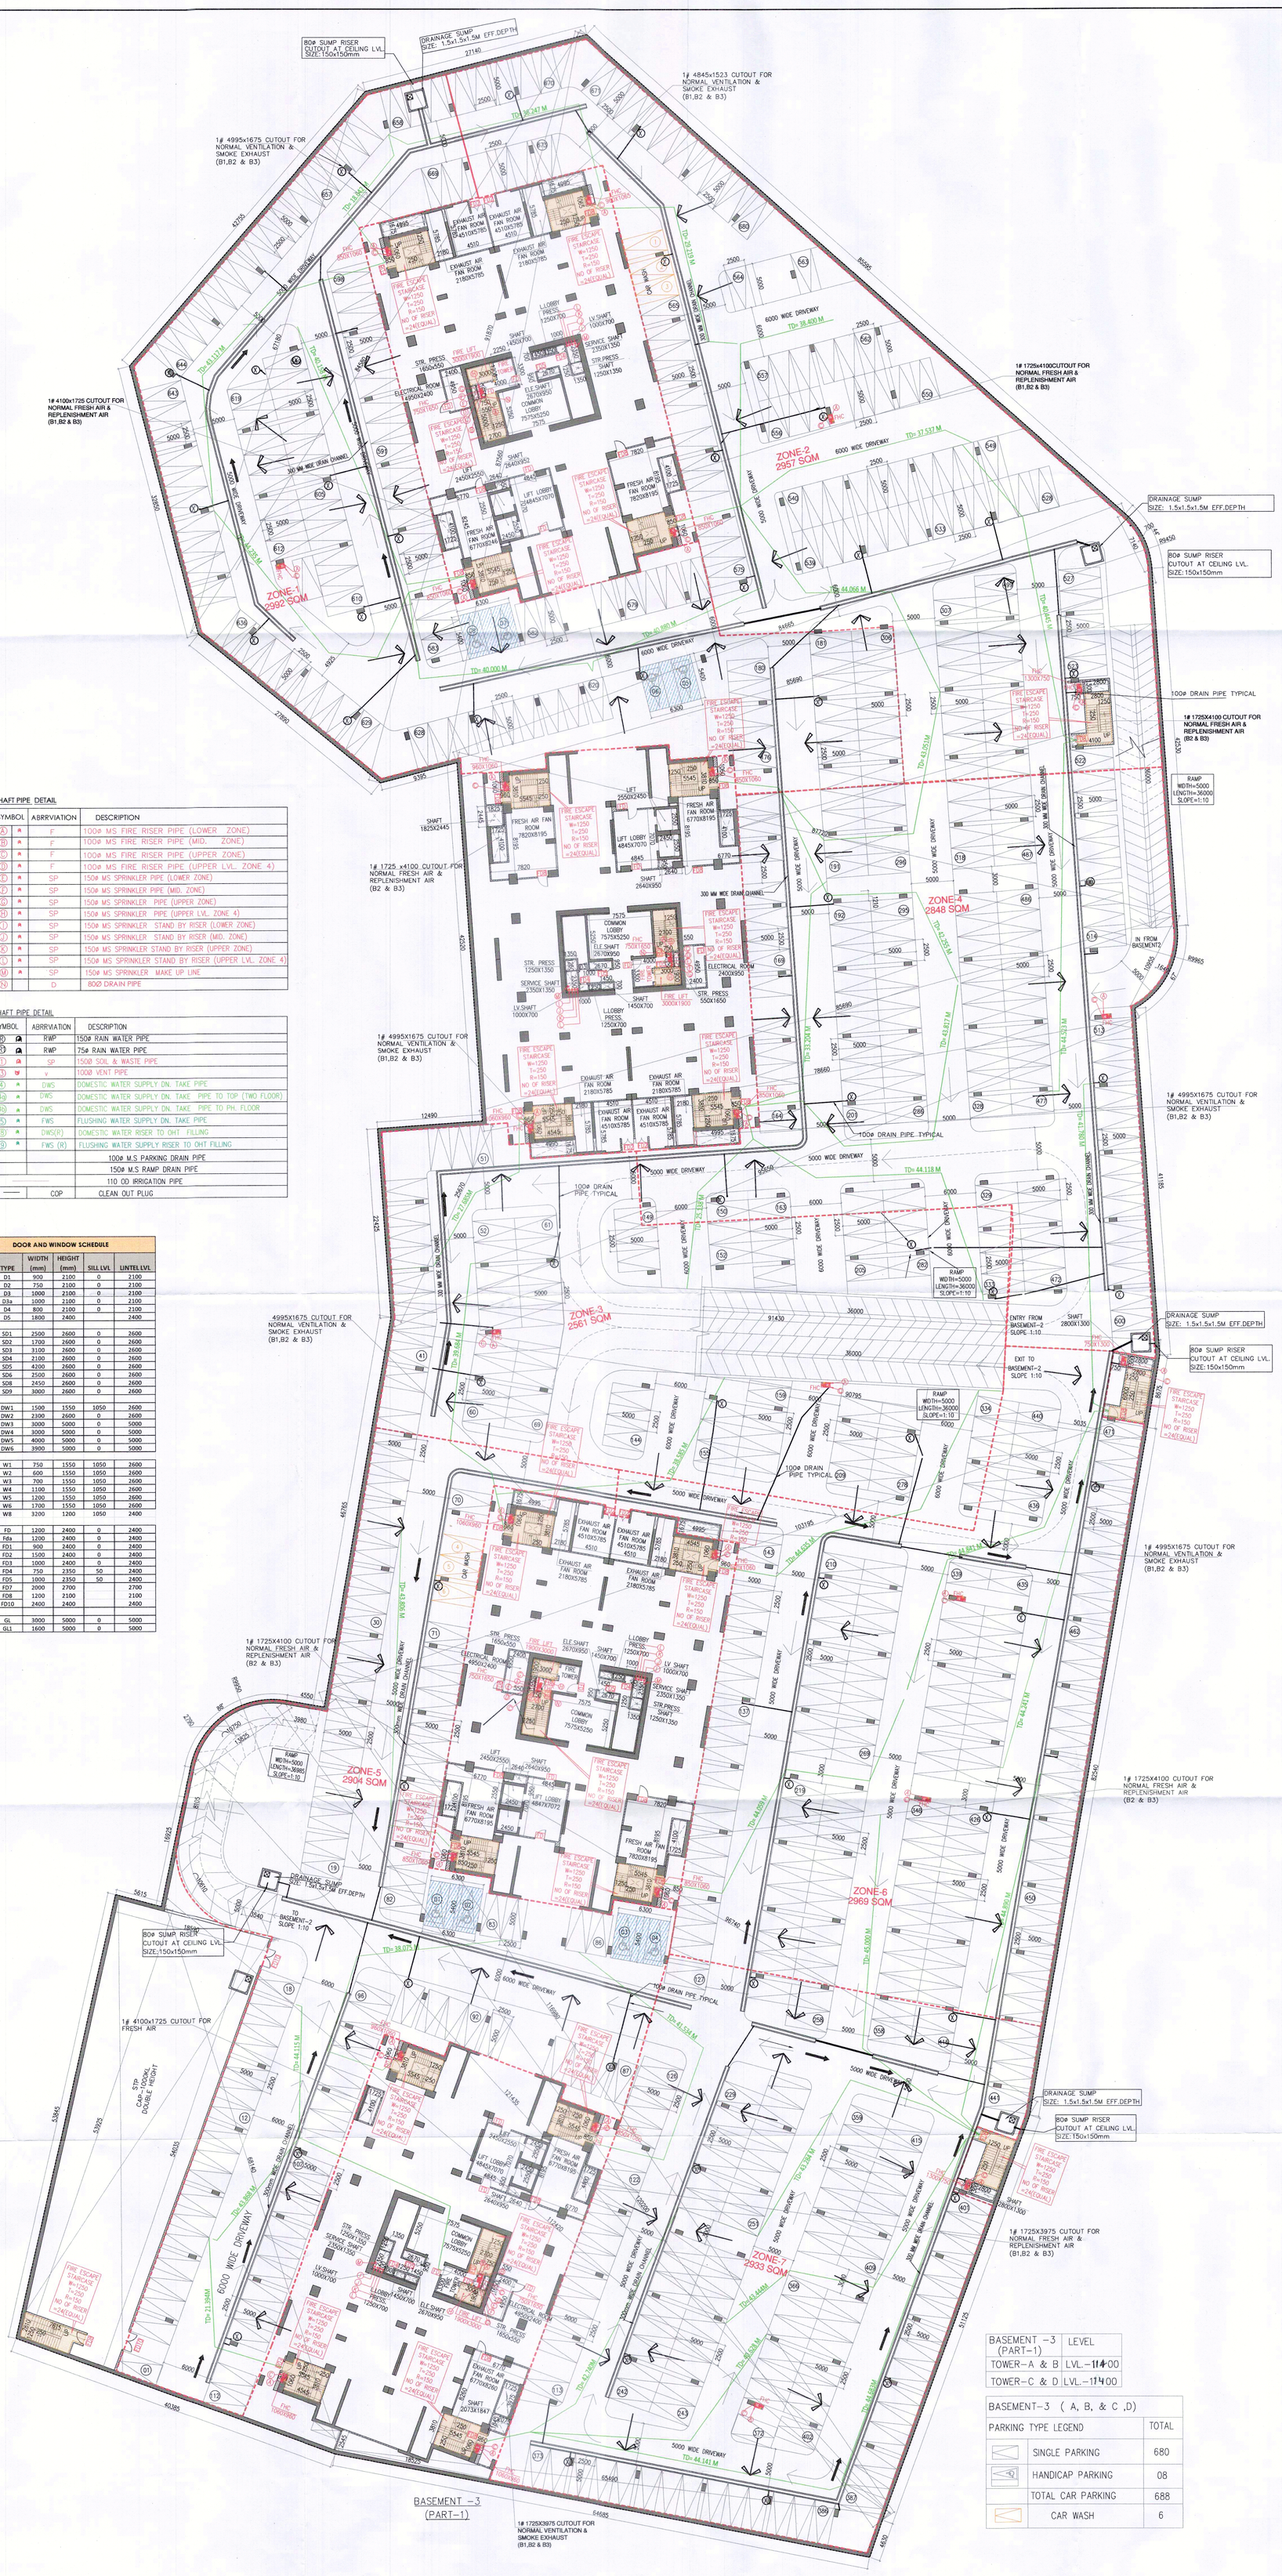

SHAFT PIPE DETAIL

SYMBOL		ABRRVIATION	DESCRIPTION
(A)	■	F	100ø MS FIRE RISER PIPE (LOWER ZONE)
(B)	■	F	100ø MS FIRE RISER PIPE (MID. ZONE)
(C)	■	F	100ø MS FIRE RISER PIPE (UPPER ZONE)
(D)	■	F	100ø MS FIRE RISER PIPE (UPPER LVL. ZONE 4)
(E)	■	SP	150ø MS SPRINKLER PIPE (LOWER ZONE)
(F)	■	SP	150ø MS SPRINKLER PIPE (MID. ZONE)
(G)	■	SP	150ø MS SPRINKLER PIPE (UPPER ZONE)
(H)	■	SP	150ø MS SPRINKLER PIPE (UPPER LVL. ZONE 4)
(I)	■	SP	150ø MS SPRINKLER STAND BY RISER (LOWER ZONE)
(J)	■	SP	150ø MS SPRINKLER STAND BY RISER (MID. ZONE)
(K)	■	SP	150ø MS SPRINKLER STAND BY RISER (UPPER ZONE)
(L)	■	SP	150ø MS SPRINKLER STAND BY RISER (UPPER LVL. ZONE 4)
(M)	■	SP	150ø MS SPRINKLER MAKE UP LINE
(N)		D	80Ø DRAIN PIPE

SHAFT PIPE DETAIL

SYMBOL		ABRRVIATION	DESCRIPTION
(R)	■	RWP	150ø RAIN WATER PIPE
(R1)	■	RWP	75ø RAIN WATER PIPE
(1)	■	SP	150Ø SOIL & WASTE PIPE
(3)	■	v	100Ø VENT PIPE
(4)	■	DWS	DOMESTIC WATER SUPPLY DN. TAKE PIPE
(4a)	■	DWS	DOMESTIC WATER SUPPLY DN. TAKE PIPE TO TOP (TWO FLOOR)
(4b)	■	DWS	DOMESTIC WATER SUPPLY DN. TAKE PIPE TO PH. FLOOR
(5)	■	FWS	FLUSHING WATER SUPPLY DN. TAKE PIPE
(6)	■	DWS(R)	DOMESTIC WATER RISER TO OHT FILLING
(6)	■	FWS (R)	FLUSHING WATER SUPPLY RISER TO OHT FILLING
			100ø M.S PARKING DRAIN PIPE
			150ø M.S RAMP DRAIN PIPE
			110 OD IRRIGATION PIPE
——		COP	CLEAN OUT PLUG

DOOR AND WINDOW SCHEDULE

SR. NO.	TYPE	WIDTH (mm)	HEIGHT (mm)	SILL LVL	LINTEL LVL
1	D1	900	2100	0	2100
2	D2	750	2100	0	2100
3	D3	1000	2100	0	2100
4	D3a	1000	2100	0	2100
5	D4	800	2100	0	2100
6	D5	1800	2400		2400
7	SD1	2500	2600	0	2600
8	SD2	1700	2600	0	2600
9	SD3	3100	2600	0	2600
10	SD4	2100	2600	0	2600
11	SD5	4200	2600	0	2600
12	SD6	2500	2600	0	2600
13	SD8	2450	2600	0	2600
14	SD9	3000	2600	0	2600
15	DW1	1500	1550	1050	2600
16	DW2	2300	2600	0	2600
17	DW3	3000	5000	0	5000
18	DW4	3000	5000	0	5000
19	DW5	4000	5000	0	5000
20	DW6	3900	5000	0	5000
21	W1	750	1550	1050	2600
22	W2	600	1550	1050	2600
23	W3	700	1550	1050	2600
24	W4	1100	1550	1050	2600
25	W5	1200	1550	1050	2600
26	W6	1700	1550	1050	2600
27	W8	3200	1200	1050	2400
28	FD	1200	2400	0	2400
29	Fda	1200	2400	0	2400
30	FD1	900	2400	0	2400
31	FD2	1500	2400	0	2400
32	FD3	1000	2400	0	2400
33	FD4	750	2350	50	2400
34	FD5	1000	2350	50	2400
35	FD7	2000	2700		2700
36	FD8	1200	2100		2100
37	FD10	2400	2400		2400
38	GL	3000	5000	0	5000
39	GL1	1600	5000	0	5000

BASEMENT -3 (PART-1)	LEVEL
TOWER-A & B	LVL.-11.400
TOWER-C & D	LVL.-11.400

BASEMENT-3 (A, B, & C ,D)	
PARKING TYPE LEGEND	TOTAL
SINGLE PARKING	680
HANDICAP PARKING	08
TOTAL CAR PARKING	688
CAR WASH	6

Note :-

1. BUILDING WILL BE DESIGNED (STRUCTURES) AS PER RELEVANT IS CODES FOR EARTH QUAKE RESISTANCE.

PROJECT

PROPOSED BUILDING PLAN OF RESIDENTIAL COLONY UNDER NEW INTEGRATED LICENSING POLICY(NILP) DATED 11.05.2022 ON LAND MEASURING 116.29625 ACRES (LICENCE NO. 219 OF 2023.DATED 25-10-23.) (AN AREA MEASURING 103.05625 ACRES MIGRATION FROM LICENCE NO. 27 OF 2012 DATED 02.04.2012 AND 13.24 ACRES AS FRESH AS FRESH APPLIED AREA) IN SECTOR -76 & 77, GURUGRAM MANESAR URBAN COMPLEX BEING DEVELOPED BY DLF LTD.IN COLLABORATION WITH LAND OWNERS AND IT' S ASSOCIATE COMPANIES

DESIGN ARCHITECTS

Arcop Associates Pvt. Ltd.,
Plot No.-36B,Institutional Area,
Sector-32,Gurgaon,
Haryana-122001.

ASSOCIATE ARCHITECTS

RSMS ARCHITECTS PVT. LTD.
69,Nora Niwas Bhawani Kunj
(Behind D2), Vasant Kunj,
New Delhi-110070.
Tel.: 011-26898616,26898617
www.rsms-arch.com

DTP (HQ) — S.T.P. (HQ) Member Secretary B.P.A.C. — S.T.P. (G) Member B.P.A.C. — C.T.P.(NR) Chairman B.P.A.C.

Consultant Architect — ATP(HQ) — Ram Avtar Bassi JD(HQ)

SANCTIONED
TO BE READ WITH THIS OFFICE
MEMO NO.: 42259
DATED : 13-12-2023

JD. — P.A. — A.T.P.

(HQ) Member BPAC

Checked and found ok for Public Health (Internal) Service only subject to comments in in forwarding letter No-239939 ...DU 6/12/23

Superintending Engineer (HQ) for Chief Engineer-I HSVP, Panchkula

ARCHITECT'S SEAL & SIGNATURE	OWNER'S SEAL & SIGNATURE
	For DLF Limited Authorised Signatory

SEP.-2023 | Scale : 1:250

Drawing Title:- BASEMENT-03(PART-01) (UNDER TOWER - A,B,C,D)

Drawing No:- BS-03