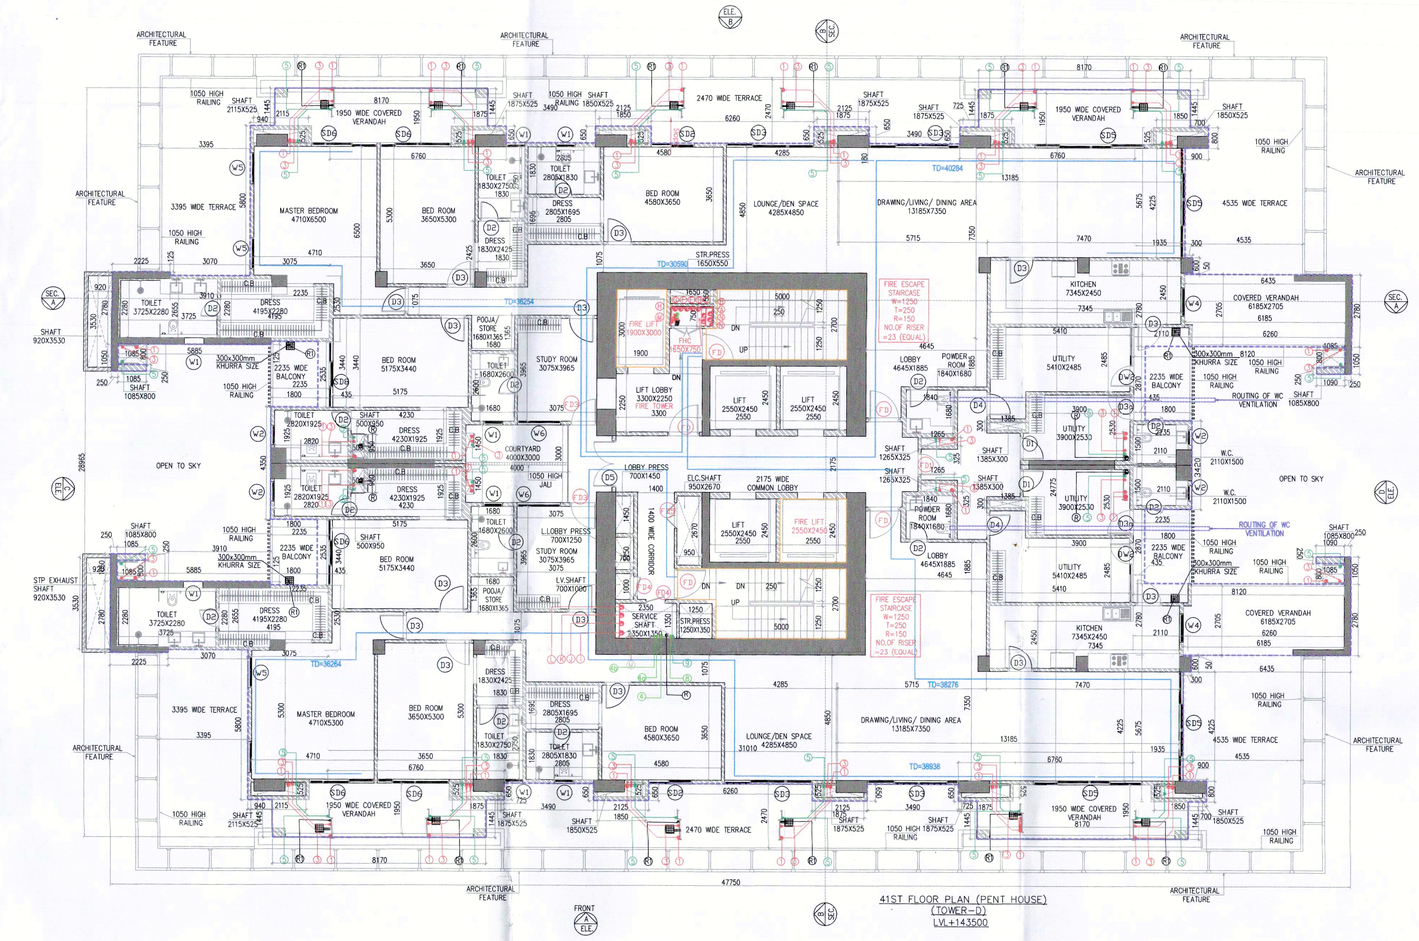

41ST FLOOR PLAN (PENT HOUSE)
(TOWER-D)
U/L+147500

SHAFT PIPE DETAIL

SYMBOL	ABBREVIATION	DESCRIPTION
(1)	R	150M MS FIRE RISER PIPE (LOWER ZONE)
(2)	R	150M MS FIRE RISER PIPE (MID. ZONE)
(3)	R	150M MS FIRE RISER PIPE (UPPER ZONE)
(4)	R	150M MS SPRINKLER PIPE (LOWER LVL ZONE 4)
(5)	R	150M MS SPRINKLER PIPE (LOWER ZONE)
(6)	R	SP	150M MS SPRINKLER PIPE (MID. ZONE)
(7)	R	SP	150M MS SPRINKLER PIPE (UPPER ZONE)
(8)	R	SP	150M MS SPRINKLER PIPE (UPPER LVL ZONE 4)
(9)	R	SP	150M MS SPRINKLER STAND BY RISER (LOWER ZONE)
(10)	R	SP	150M MS SPRINKLER STAND BY RISER (MID. ZONE)
(11)	R	SP	150M MS SPRINKLER STAND BY RISER (UPPER ZONE)
(12)	R	SP	150M MS SPRINKLER STAND BY RISER (UPPER LVL ZONE 4)
(13)	R	SP	150M MS SPRINKLER - WAKE UP LINE
(14)	R	SP	65M SHOWER PIPE

SHAFT PIPE DETAIL

SYMBOL	ABBREVIATION	DESCRIPTION
(A)	RWP	150M RAIN WATER PIPE
(B)	RWP	75M RAIN WATER PIPE
(C)	SP	75M SOIL & WASTE PIPE
(D)	W	100M VENT PIPE
(E)	A	DWC	DOMESTIC WATER SUPPLY 3N. TANK PIPE
(F)	A	DWC	DOMESTIC WATER SUPPLY 3N. TANK PIPE TO TOP 2 TWO FLOOR
(G)	A	DWC	DOMESTIC WATER SUPPLY 3N. TANK PIPE TO 7TH. FLOOR
(H)	A	FWC	FLUSHING WATER SUPPLY 3N. TANK PIPE
(I)	A	DWC(R)	DOMESTIC WATER RISER TO SHAT. FILLING
(J)	A	FWC (R)	FLUSHING WATER SUPPLY RISER TO SHAT FILLING
X			150M M.S PARKING DRAIN PIPE
X1			150M M.S RAMP DRAIN PIPE

DOOR AND WINDOW SCHEDULE

SR. NO.	TYPE	WIDTH (mm)	HEIGHT (mm)	SILL LVL	LINTEL LVL
1	D1	900	2100	0	2100
2	D2	1000	2100	0	2100
3	D3	1500	2100	0	2100
4	D3A	1050	2100	0	2100
5	D4	800	2100	0	2100
6	D5	1900	2400	0	2400
7	W1	2100	1500	0	1500
8	W2	1700	2600	0	2600
9	W3	2100	2600	0	2600
10	W4	2100	2600	0	2600
11	W5	4200	2600	0	2600
12	W6	2100	2600	0	2600
13	W8	2400	2600	0	2600
14	W9	4200	2600	0	2600
15	DW1	2300	1150	1050	2600
16	DW2	2300	1150	1050	2600
17	DW3	4200	1050	0	1050
18	DW4	9000	5050	0	5050
19	DW5	4200	1050	0	1050
20	DW6	3900	5050	0	5050
21	W1	750	1050	1050	2600
22	W2	600	1050	1050	2600
23	W3	1200	1050	1050	2600
24	W4	1200	1050	1050	2600
25	W5	1200	1050	1050	2600
26	W6	1700	1050	1050	2600
27	W8	3200	1050	1050	2600
28	D1	1000	2400	0	2400
29	D2	1000	2400	0	2400
30	D3	1500	2400	0	2400
31	D3A	1050	2400	0	2400
32	D4	750	2100	50	2400
33	D5	1000	2100	50	2400
34	D6	1200	2100	0	2400
35	D7	1200	2100	0	2400
36	D8	2400	2400	0	2400
37	D10	2400	2400	0	2400
38	D1	2000	5050	0	5050
39	D2	1900	5050	0	5050

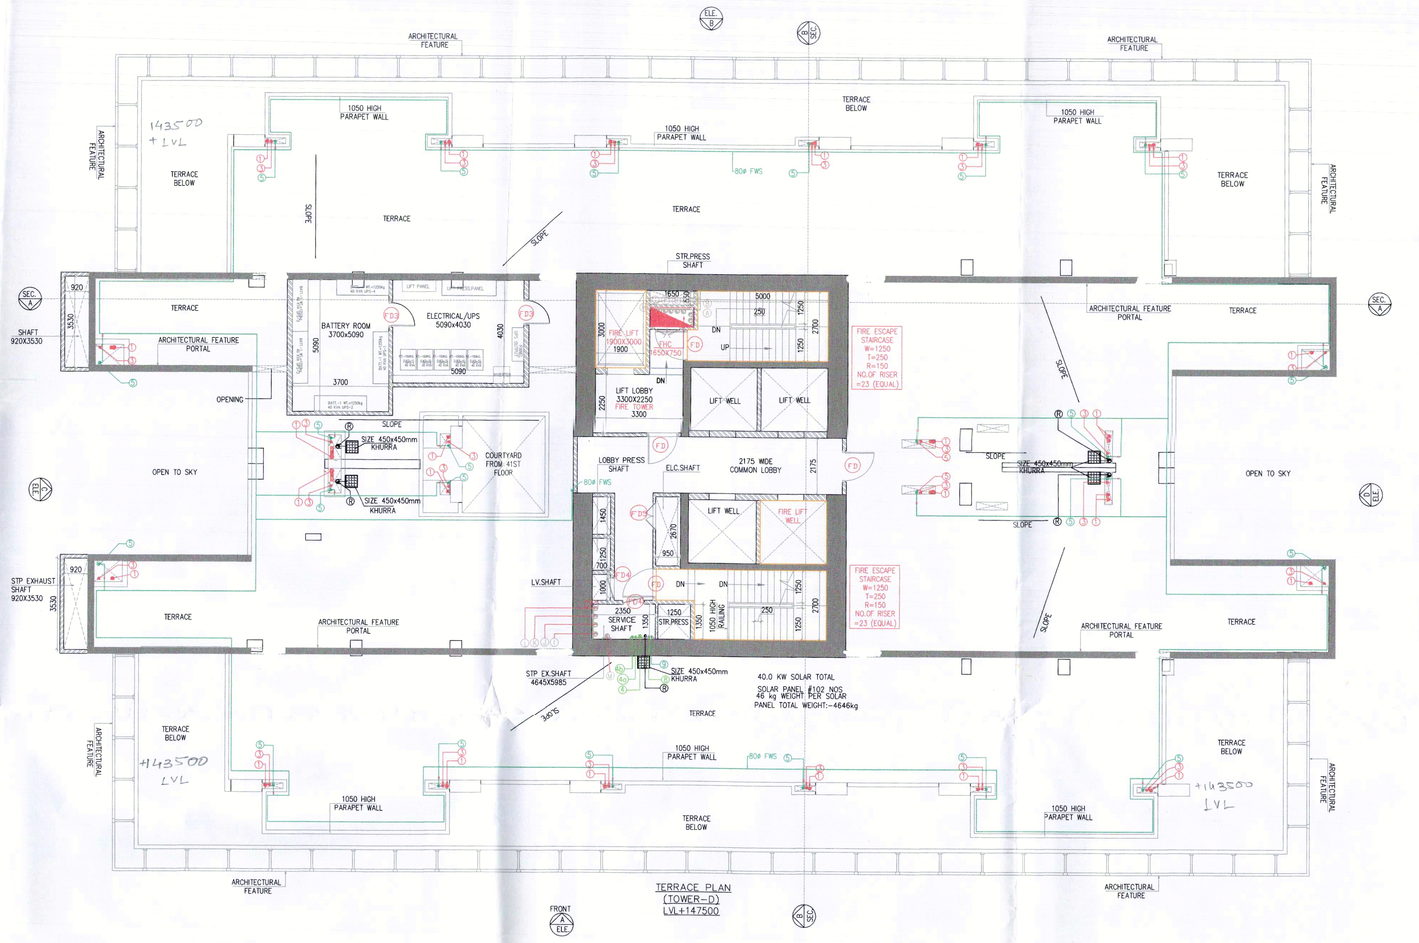

TERRACE PLAN
(TOWER-D)
U/L+147500

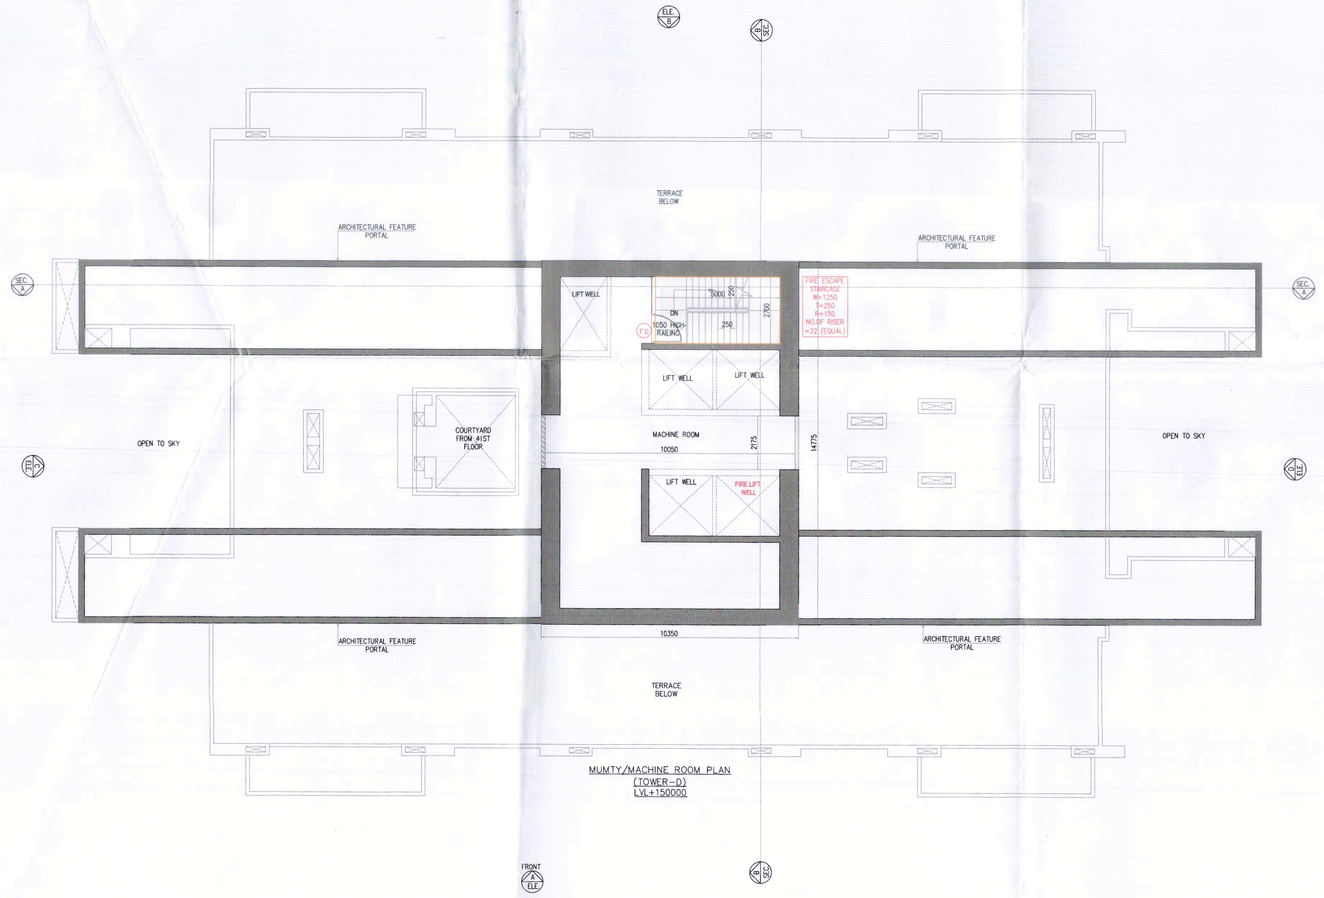

MUMTY/MACHINE ROOM PLAN
(TOWER-D)
U/L+150000

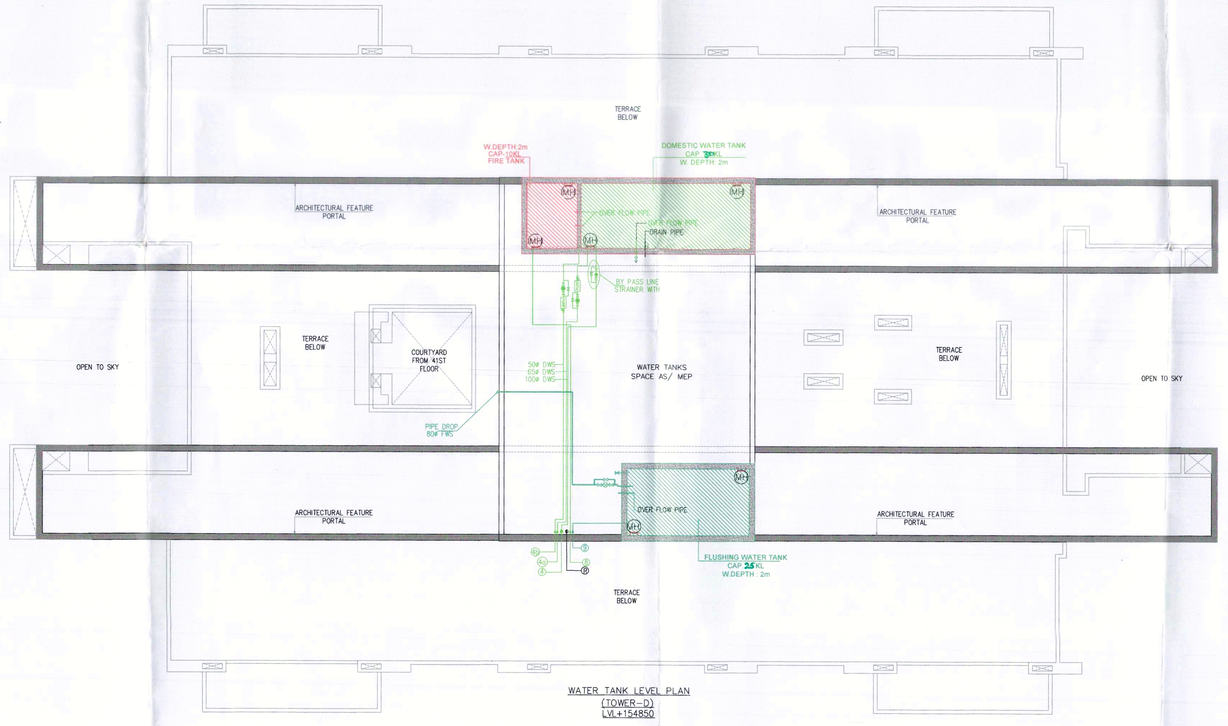

WATER TANK LEVEL PLAN
(TOWER-D)
U/L+156500

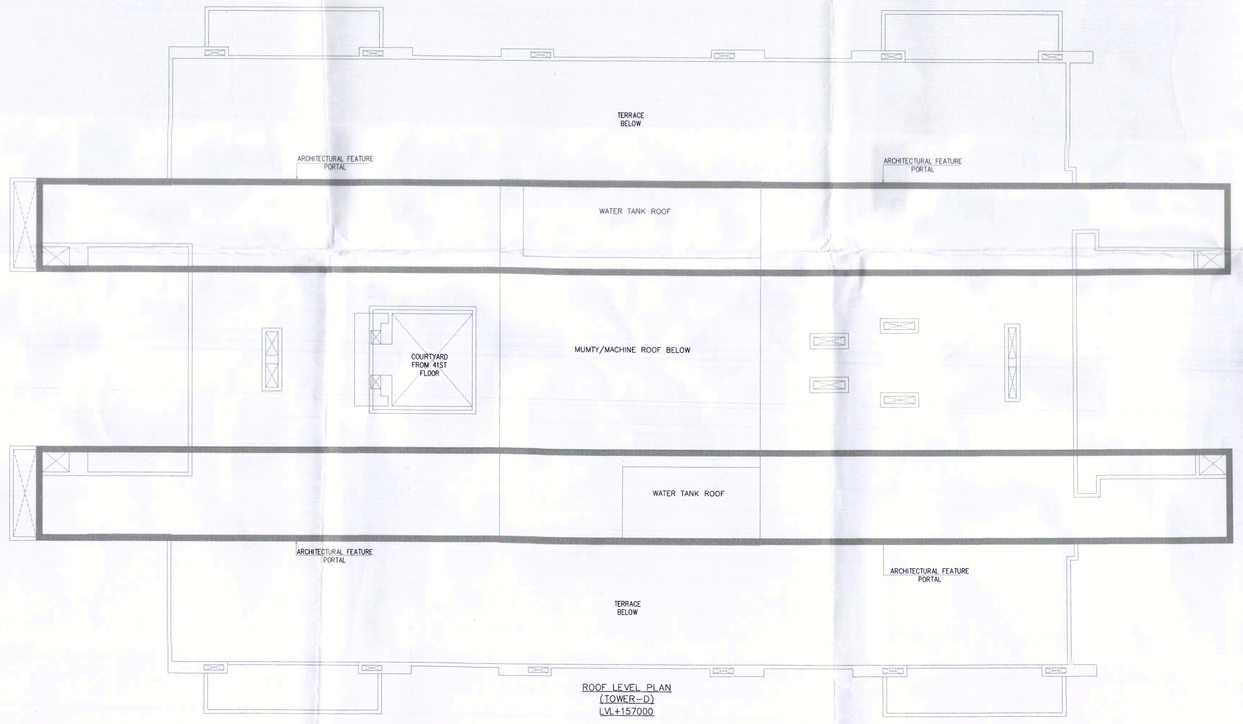

ROOF LEVEL PLAN
(TOWER-D)
U/L+157000

Note :-

1. BUILDING WILL BE DESIGNED (STRUCTURES) AS PER RELEVANT IS CODES FOR EARTH QUAKE RESISTANCE.

PROJECT

PROPOSED BUILDING PLAN OF RESIDENTIAL COLONY UNDER NEW INTEGRATED LICENSING POLICY(NILP) DATED 11.05.2022 ON LAND MEASURING 116.29625 ACRES (LICENCE NO. 219 OF 2023,DATED 25-10-23.) (AN AREA MEASURING 103.05625 ACRES MIGRATION FROM LICENCE NO. 27 OF 2012 DATED 02.04.2012 AND 13.24 ACRES AS FRESH AS FRESH APPLIED AREA) IN SECTOR -76 & 77, GURUGRAM MANESAR URBAN COMPLEX BEING DEVELOPED BY DLF LTD. IN COLLABORATION WITH LAND OWNERS AND IT`S ASSOCIATE COMPANIES

ARCHITECTS

RSMS ARCHITECTS PVT. LTD.
69,Nora Niwas Bhawani Kunj
(Behind D2), Vasant Kunj,
New Delhi-110070.
Tel.: 011-26898616,26898617
www.rsms-arch.com

DTP (HO) | STP (HO) Sachin Sawhney B.P.A.C. | STP (HO) Ravi Kumar (DM) B.P.A.C.

Consultant Architect | ATP(HO) | CP (Dinesh Kumar) PA(HO)

Checked and found ok for Public Health (internal) Service only subject to comments in forwarding letter No. 19315 dated 30/1/24

Superintending Engineer (HQ) for Chief Engineer-I HSVP, Panchkula | FSDP (HQ) Member BPAC

TO BE RETURNED TO THIS OFFICE
RETURD NO.: 98-37
DATED: 06/03/24

ARCHITECT'S SEAL & SIGNATURE	OWNER'S SEAL & SIGNATURE
	For DLF Limited Authorised Signatory

JAN.-2024 | Scale : 1:100

Drawing Title:-
41ST PENTHOUSE FLOOR ,TERRACE, MACHINE ROOM & WATER TANK, ROOF PLAN (TOWER -D)

Drawing No:-
TA-08

PHASE-VI