DRG NO. BCST-03

ARCHITECT(H.Q.) S.T.P. Member Secretary B.P.C. S.T.P.(G) Member B.P.C. C.T.P.(Hr.) Chairman B.P.C.

Checked and found ok for Public Health (Internal) Service only subject to comments in forwarding letter No. SE(HQ) 79868 Dt. 6/5/21

Superintending Engineer (HQ) HSVP, Panchkula

Ram Avtar Bassi AD(HQ)

DD(HQ) Member BPC

JD PA ATP

This is a "PROVISIONAL BUILDING PLAN" approved only for the purpose of inviting objections from the general public

KEY PLAN

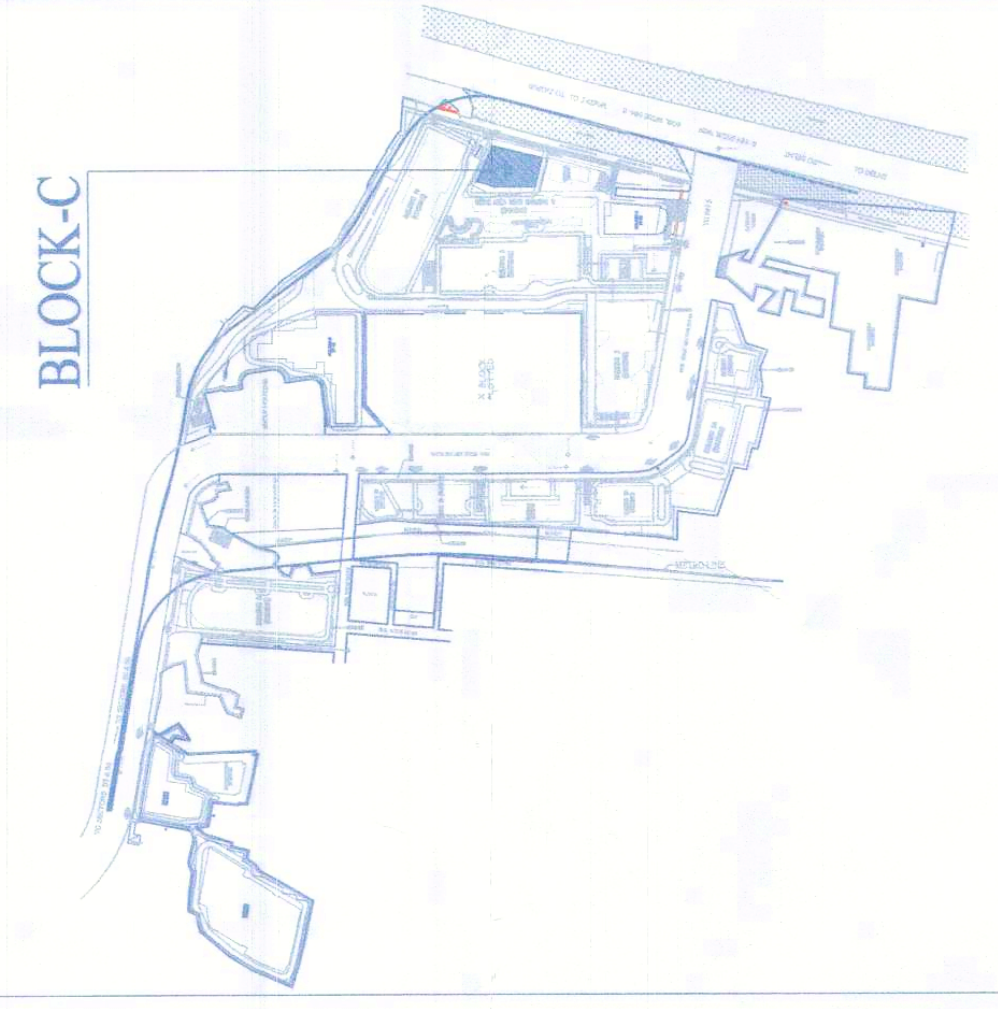

Architect Hafeez Contractor
29 Bank Street, Bombay 400 023. Tel:2661920

RSMS ARCHITECTS

RSMS ARCHITECTS PVT. LTD.
69,Nora Niwas Bhawani Kunj
(Behind D2), Vasant Kunj,
New Delhi-110070.
Tel.:011-26898616,26898617
www.rsms-arch.com

Project:
PROPOSED BUILDING PLANS OF BUILDING - B AND REVISED BUILDING PLANS OF BUILDING-C, D, E, & F IN CYBER CITY UNDER TRANSIT ORIENTED DEVELOPMENT (TOD)POLICY FOR MIX LAND USED COLONY(70% IT/ITES/+30% COMMERCIAL) MEASURING 108.55922 ACRES IN SECTOR 24, 25 & 25-A, GURUGRAM MANESAR URBAN COMPLEX BEING DEVELOPED BY DLF CYBER CITY DEVELOPERS LIMITED

OWNER: DLF
DLF Cyber City Developers Ltd.
10th Floor DLF Gateway Tower,
DLF Cyber City, Gurugram,
Haryana Pin:122002

DRAWING TITLE:- **BLOCK-C SITE PLAN (IRRIGATION,EXTERNAL FIRE HYDRANT & WATER SUPPLY SCHEME)**

REVISION	JOB NO:-	DRG NO. BCST-03
	SCALE:- 1:500	DATE:- 01-04-2021
		NORTH:- N
FILE:-	DEALT BY:-	CHECKED BY:
APPROVED BY:-		
ARCHITECT'S SEAL & SIGNATURE		OWNER'S SEAL & SIGNATURE

DLF Cyber City Developers Ltd.

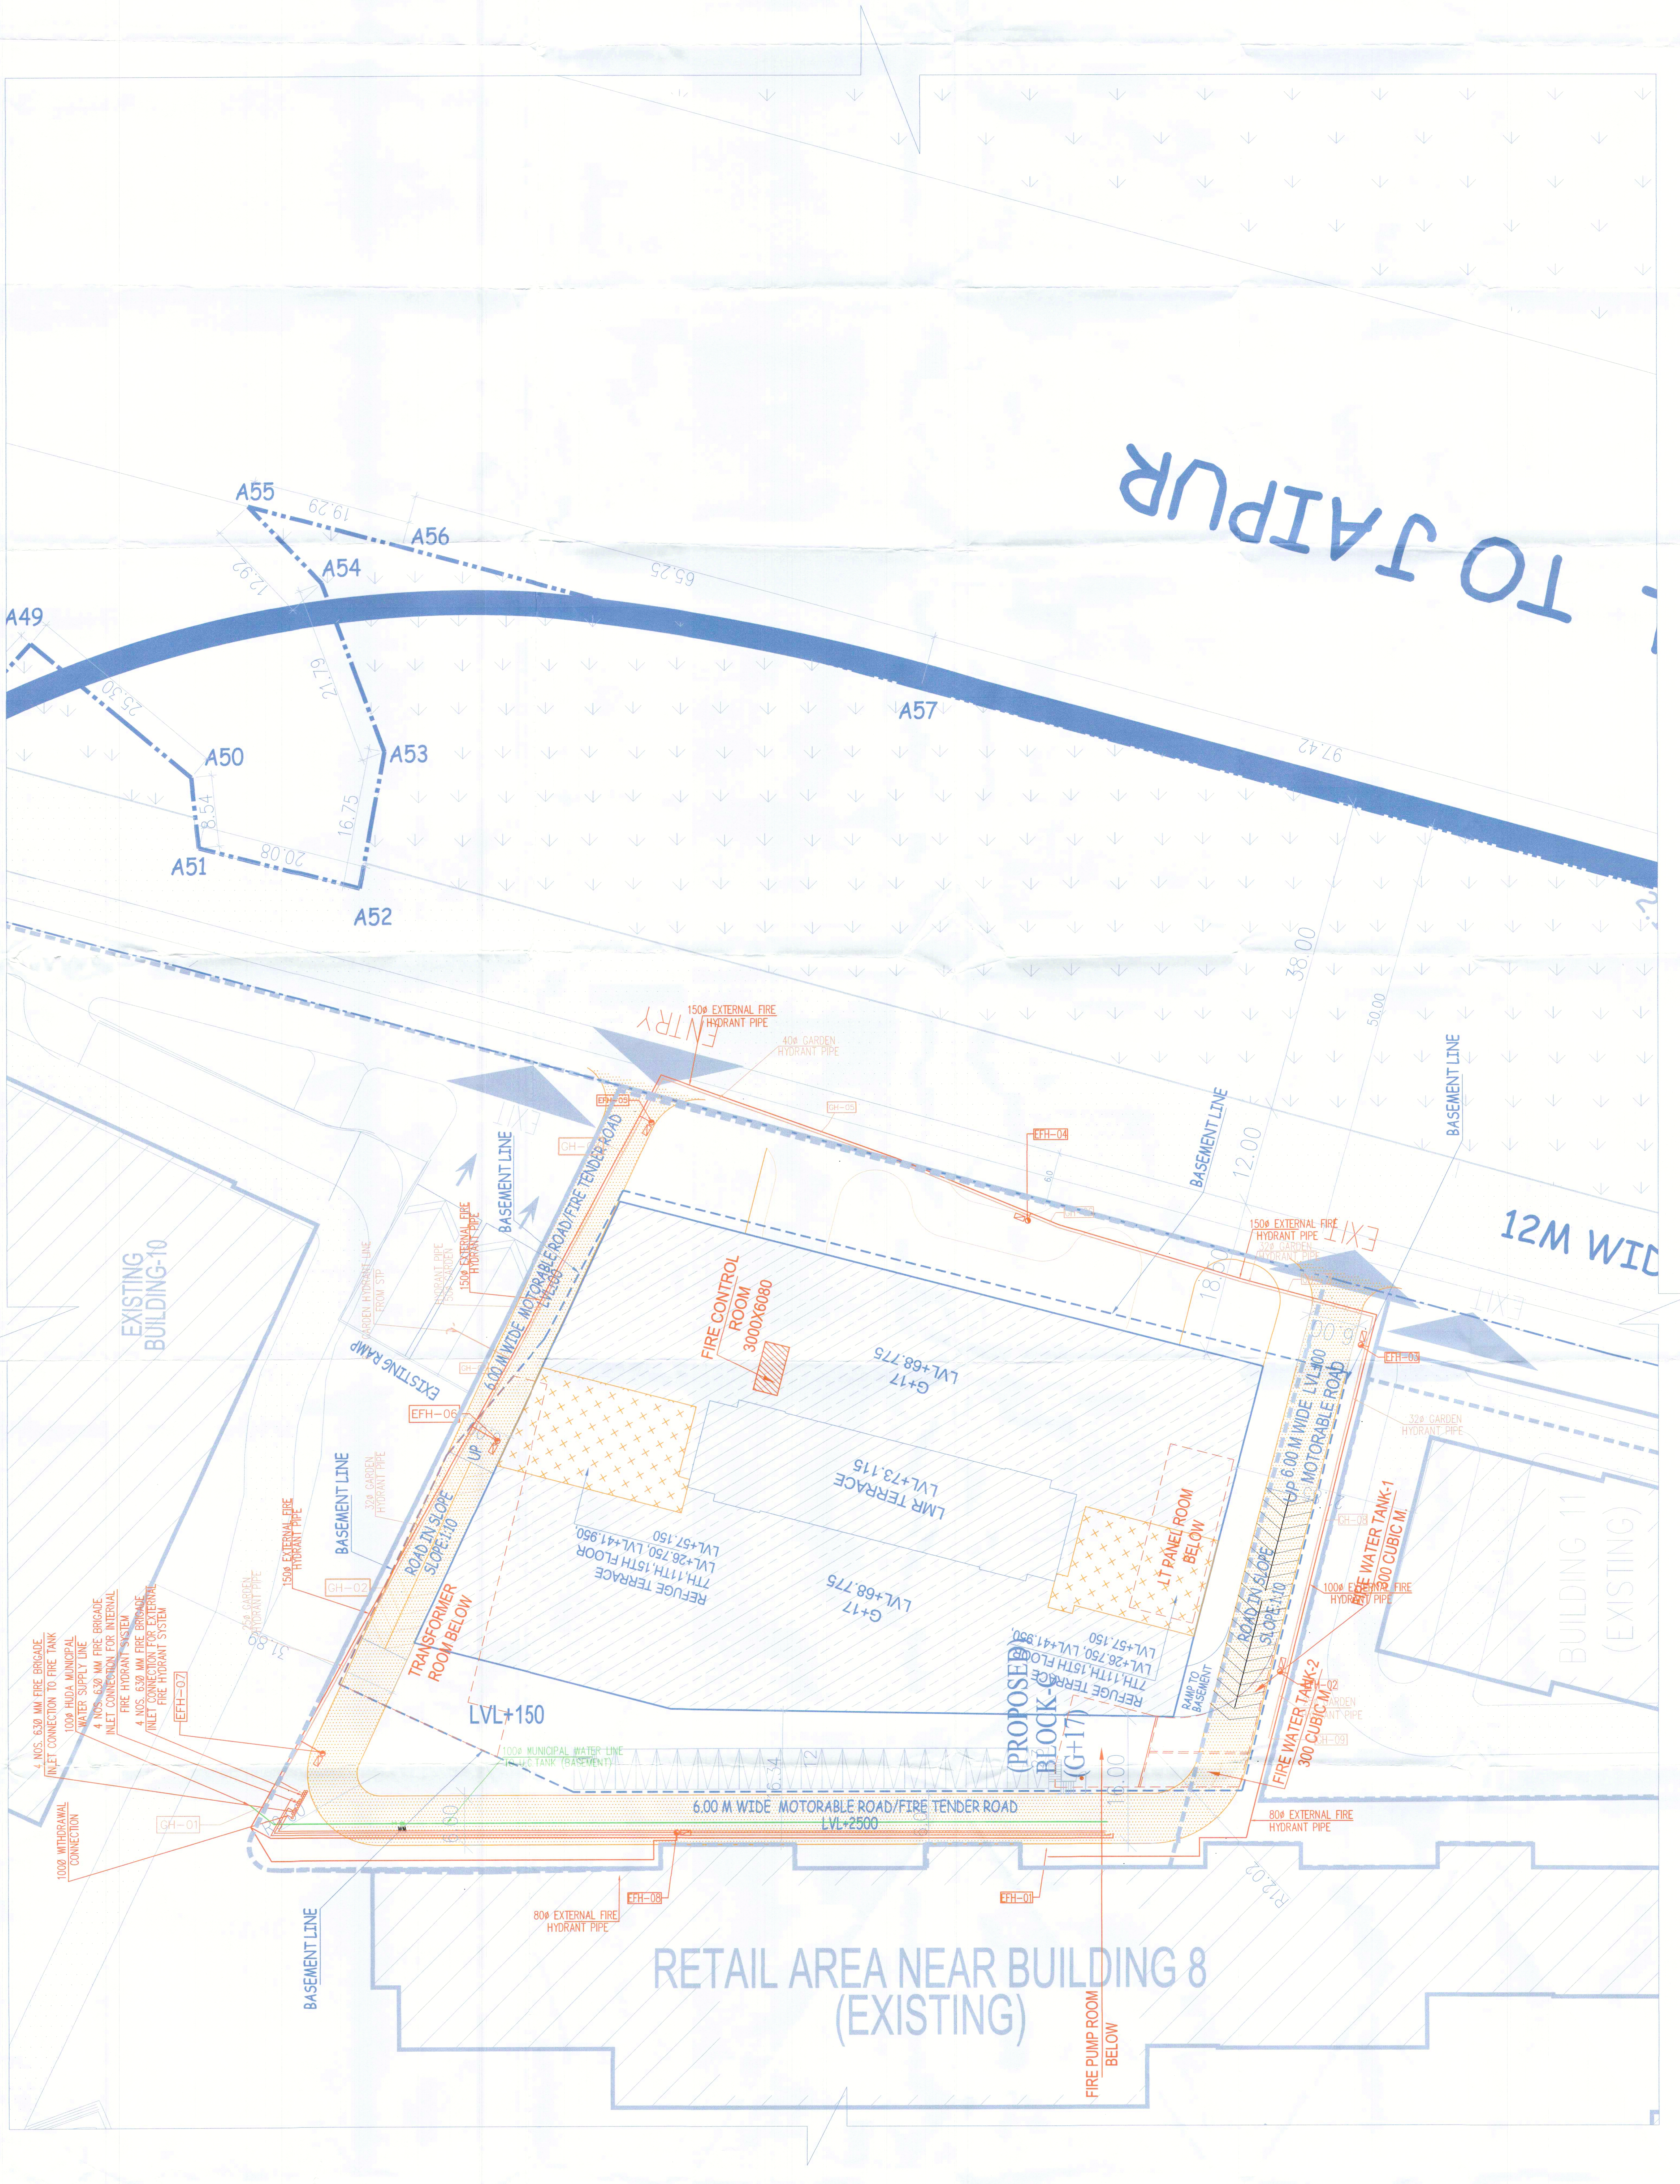
TO JAIPUR
A49
A50
A51
A52
A53
A54
A55
A56
A57
19.29
17.92
65.25
25.30
21.79
8.54
16.75
20.08
97.42
38.00
50.00
12.00
12M WID
ENTRY
EXIT
150ø EXTERNAL FIRE HYDRANT PIPE
40ø GARDEN HYDRANT PIPE
32ø GARDEN HYDRANT PIPE
80ø EXTERNAL FIRE HYDRANT PIPE
100ø EXTERNAL FIRE HYDRANT PIPE
EFH-01
EFH-02
EFH-03
EFH-04
EFH-05
EFH-06
EFH-07
EFH-08
GH-01
GH-02
GH-05
BASEMENT LINE
EXISTING BUILDING-10
EXISTING RAMP
6.00 M WIDE MOTORABLE ROAD/FIRE TENDER ROAD LVL+150
6.00 M WIDE MOTORABLE ROAD/FIRE TENDER ROAD LVL+2500
6.00 M WIDE LVL+100 MOTORABLE ROAD
ROAD IN SLOPE SLOPE 1:10
UP
FIRE CONTROL ROOM 3000X6080
G+17 LVL+68.775
LMR TERRACE LVL+73.115
REFUGE TERRACE 7TH,11TH,15TH FLOOR LVL+26.750, LVL+41.950, LVL+57.150
TRANSFORMER ROOM BELOW
LT PANEL ROOM BELOW
(PROPOSED) BLOCK-C (G+17)
RAMP TO BASEMENT
FIRE WATER TANK-1 300 CUBIC M.
FIRE WATER TANK-2 300 CUBIC M.
LVL+150
100ø MUNICIPAL WATER LINE (TO FIRE TANK TRANSMENT)
4 NOS. 63Ø MM FIRE BRIGADE INLET CONNECTION TO FIRE TANK
100Ø HUDA MUNICIPAL WATER SUPPLY LINE
4 NOS. 63Ø MM FIRE BRIGADE INLET CONNECTION FOR INTERNAL FIRE HYDRANT SYSTEM
4 NOS. 63Ø MM FIRE BRIGADE INLET CONNECTION FOR EXTERNAL FIRE HYDRANT SYSTEM
100Ø WITHDRAWAL CONNECTION
31.89
R12.02
BUILDING 11 (EXISTING)
RETAIL AREA NEAR BUILDING 8 (EXISTING)
FIRE PUMP ROOM BELOW